

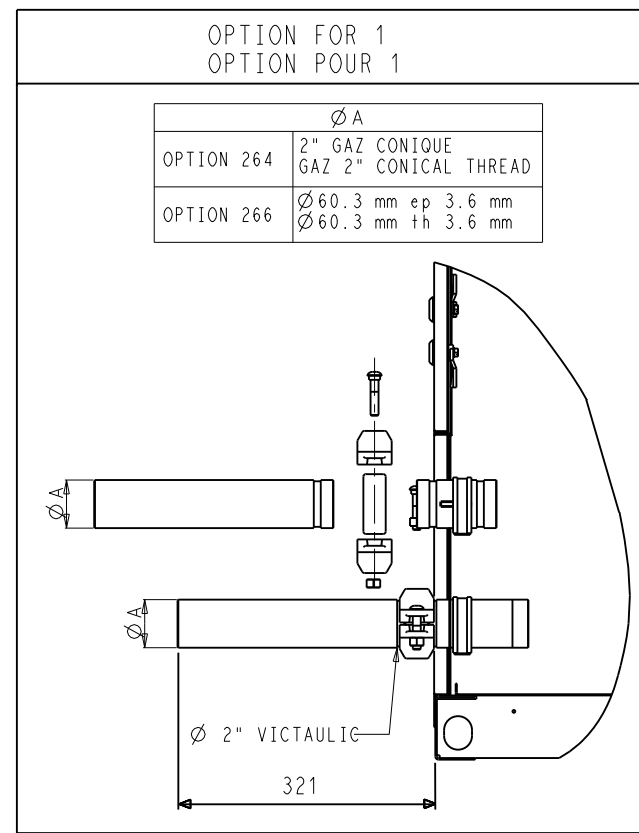


OVERALL DIMENSIONS AND WATER INLET AND OUTLET CONNECTION

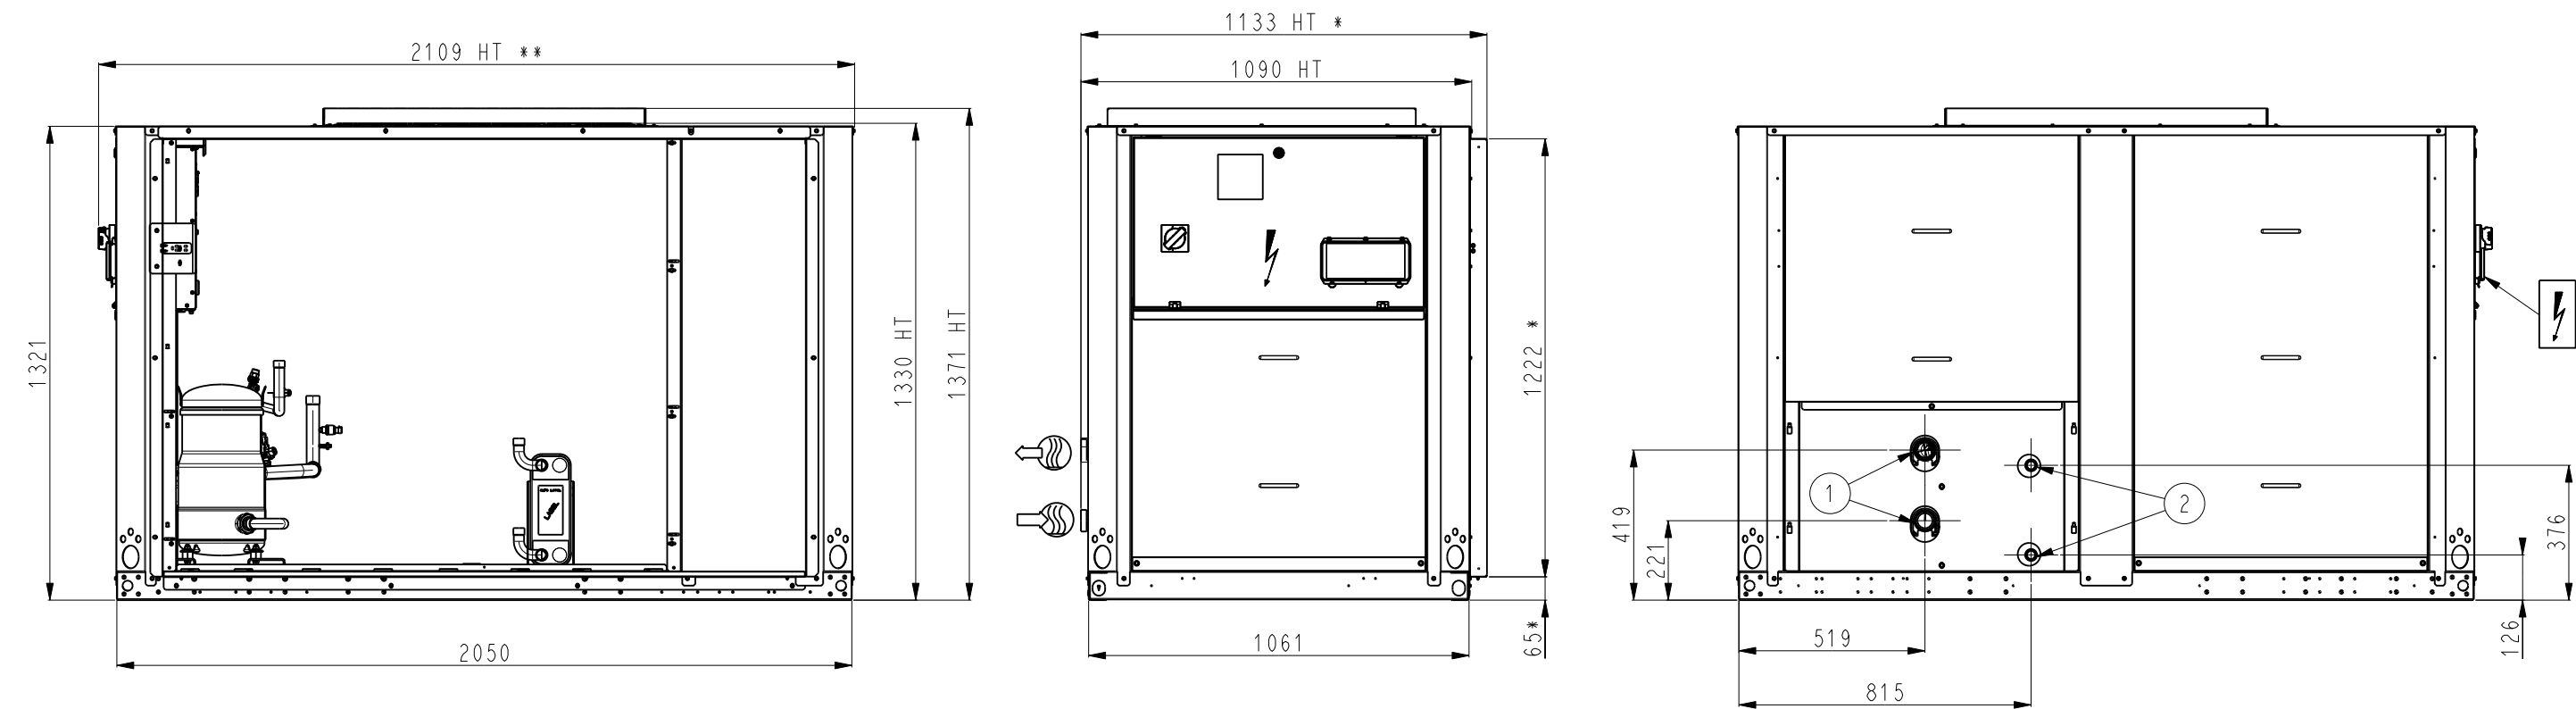


* OPTION 12A

DETAIL FOR 1
DETAIL POUR

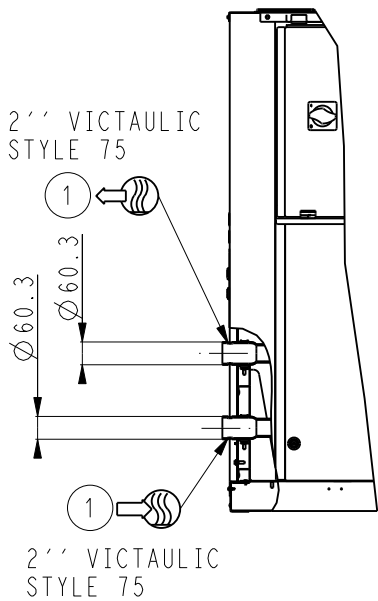

DETAIL FOR 2
DETAIL POUR


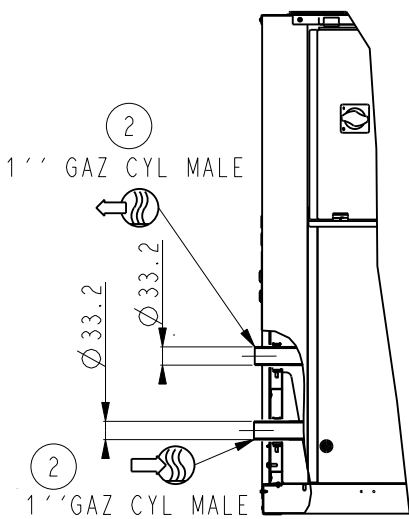


② OPTION RÉCUPÉRATION PARTIELLE DE CHALEUR SEULEMENT
OPTION PARTIAL HEAT RECOVERY ONLY


GRILLE EN OPTION
GRILL ON OPTION

TOLERANCE	30RB 040R-080R		DATE	Feuille Sheet 1/7
±10	*		11-Aug-23	Indice
		00DCG000393300		D

COG AND LIFTING INFORMATION

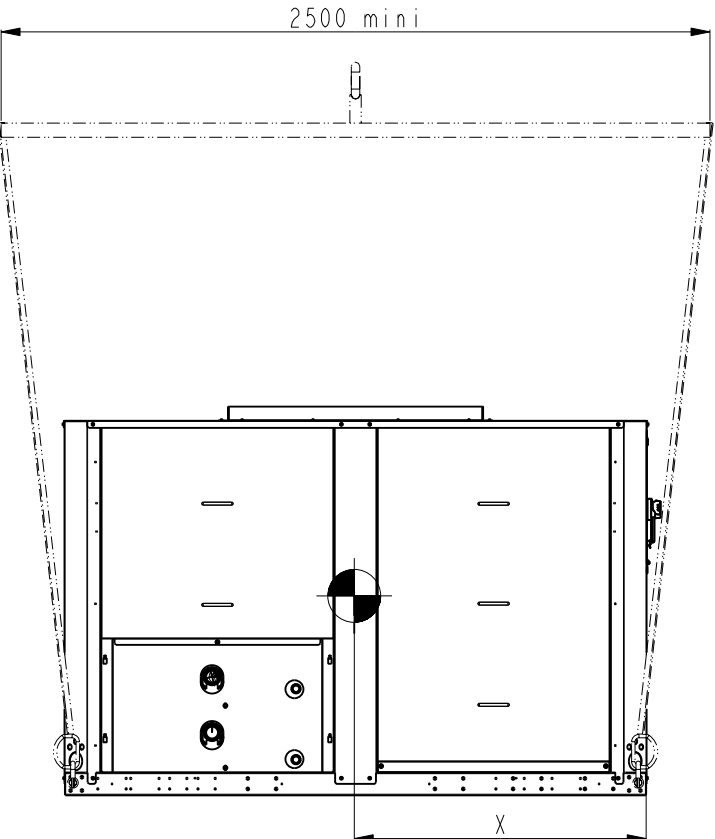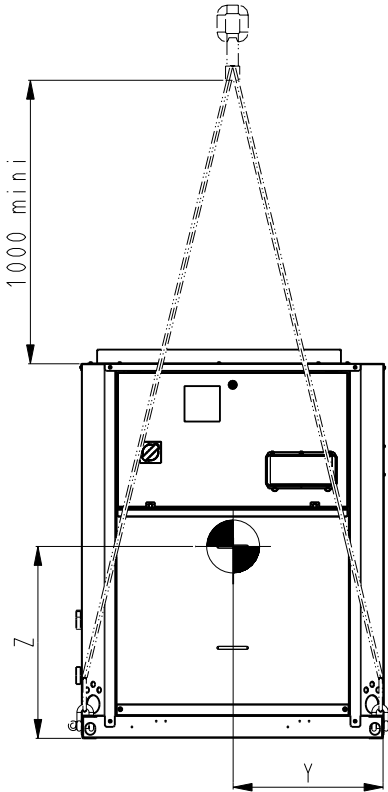


X (mm)	Y (mm)	Z (mm)
760±70	493±35	538±25



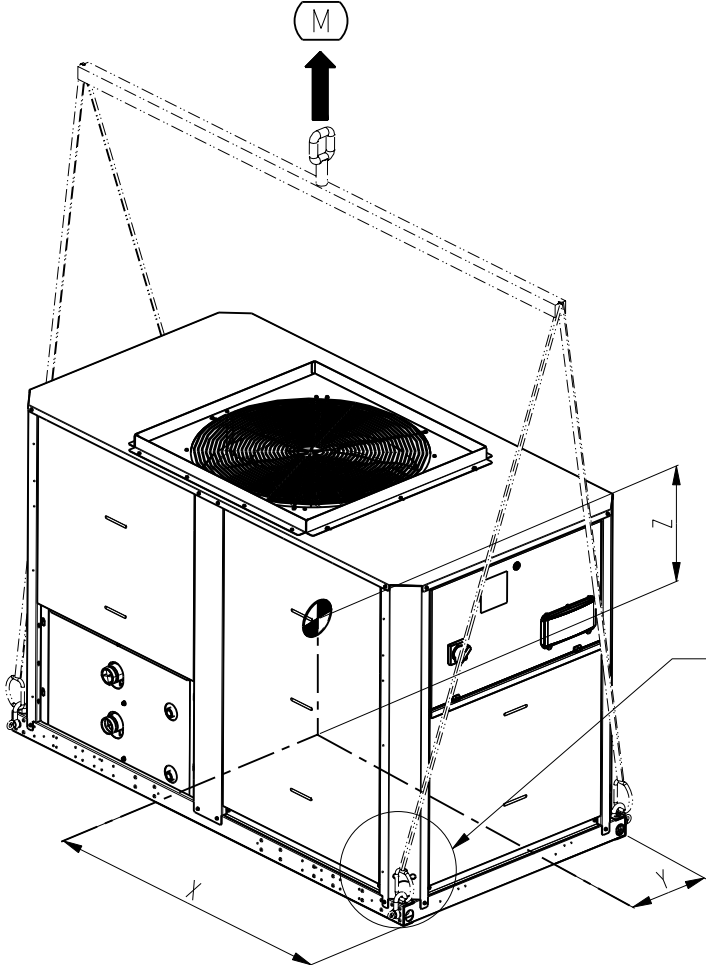


STD / OPT12

VOIR DETAIL B
SEE DETAIL

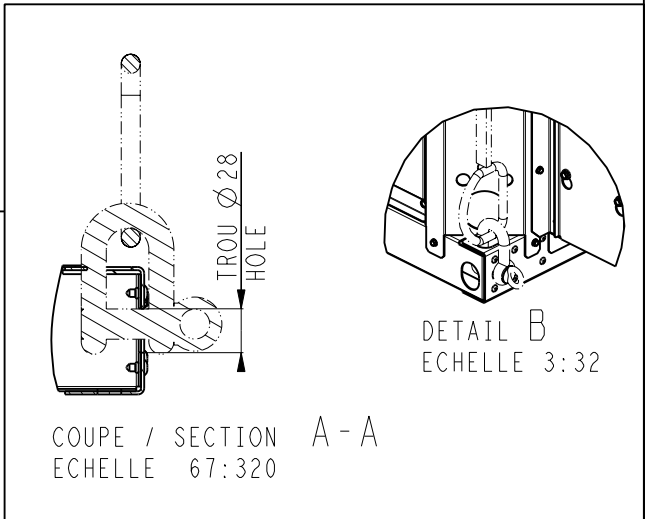


OPT 12A / 23B



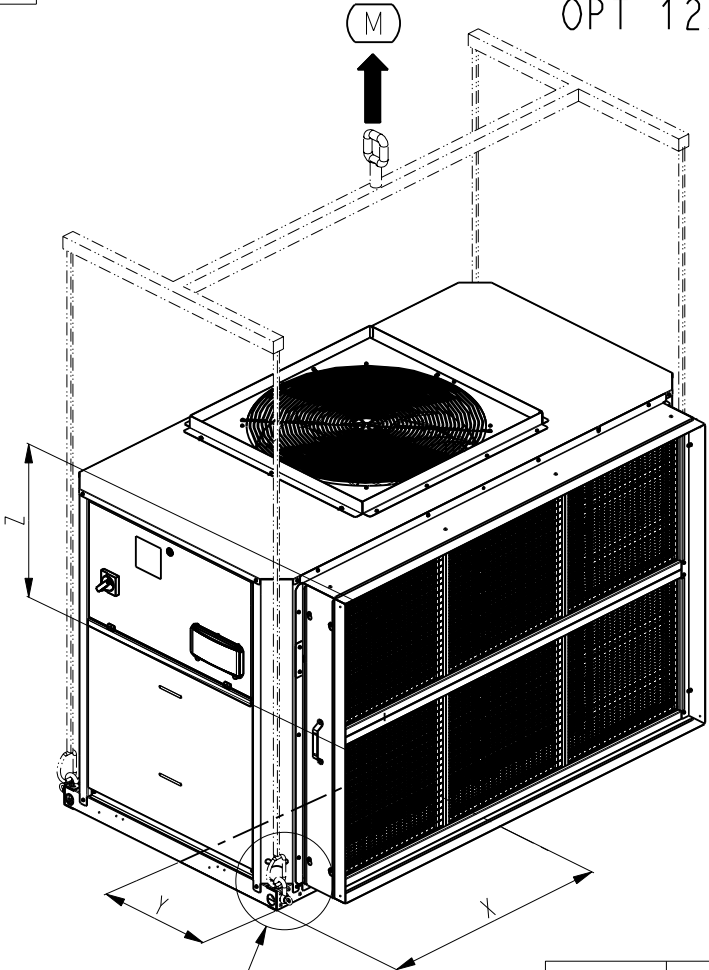
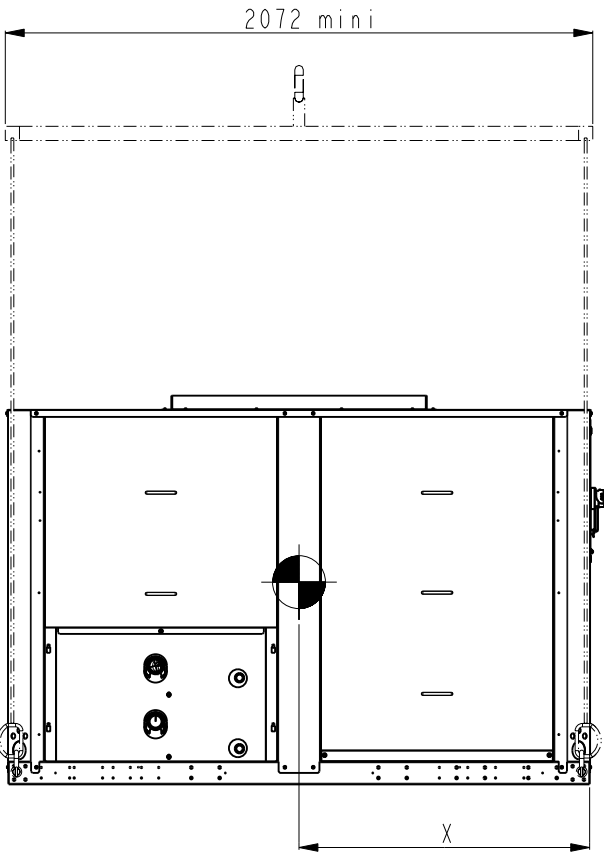
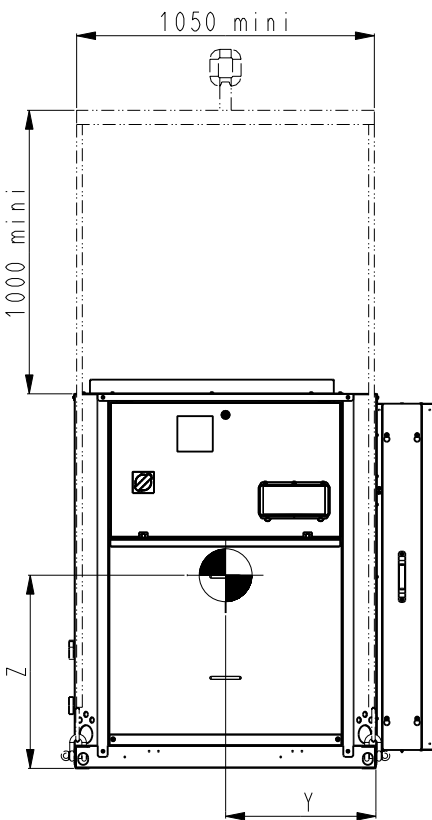


VOIR DETAIL B
SEE DETAIL

TOLERANCE	30RB 040R-080R	Carrier	DATE	Feuille
±10	*		11-Aug-23	Sheet
				2/7
				Indice
				D

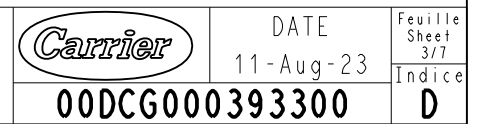

SERVICE AERA / SERVICE AND RELIEF VALVE INFORMATION

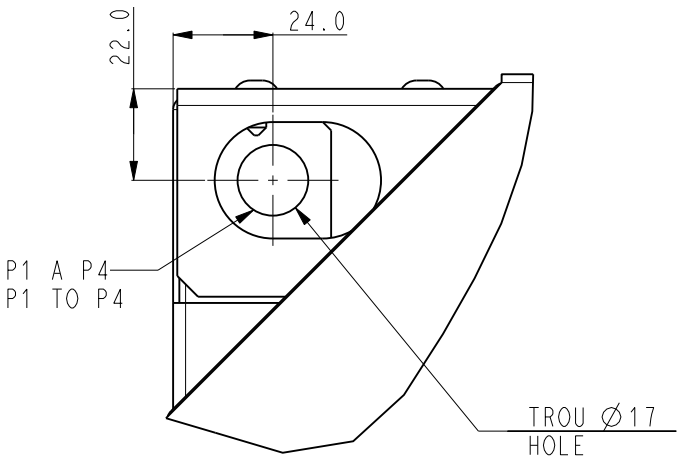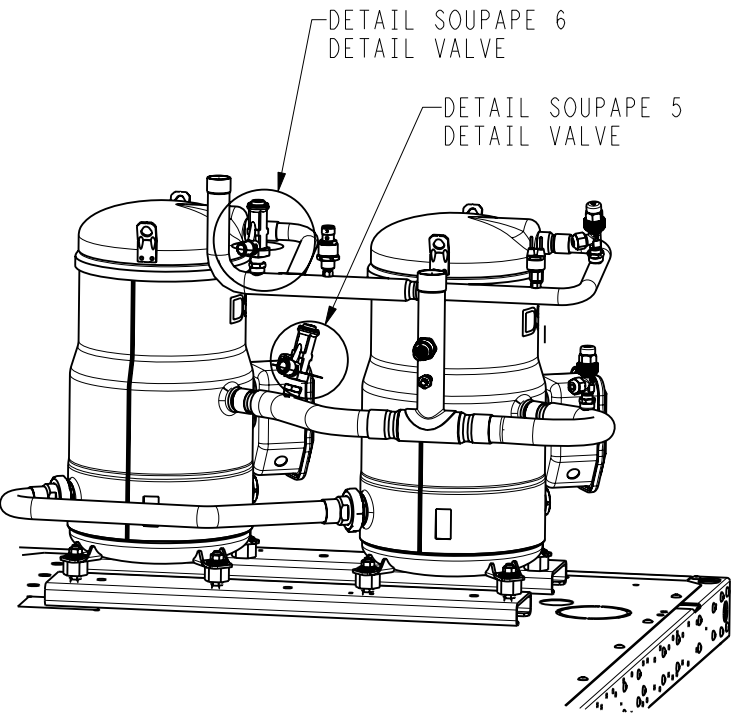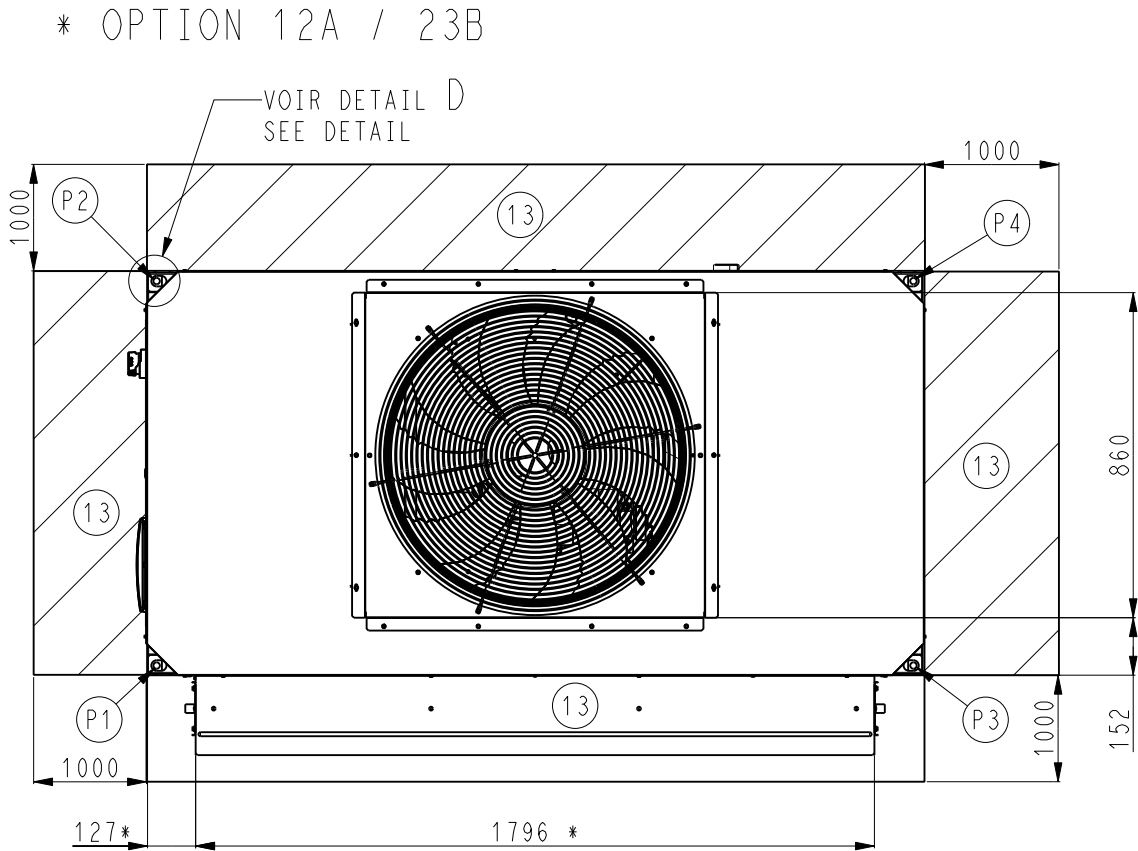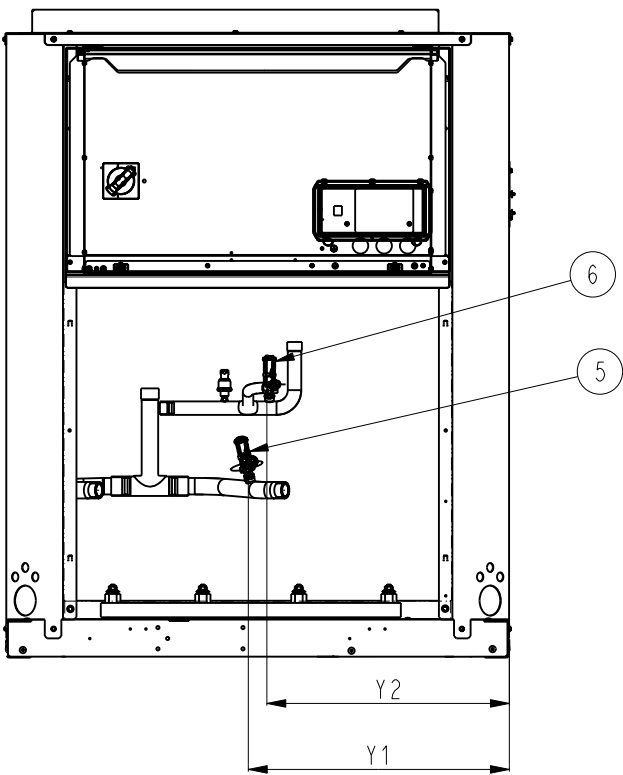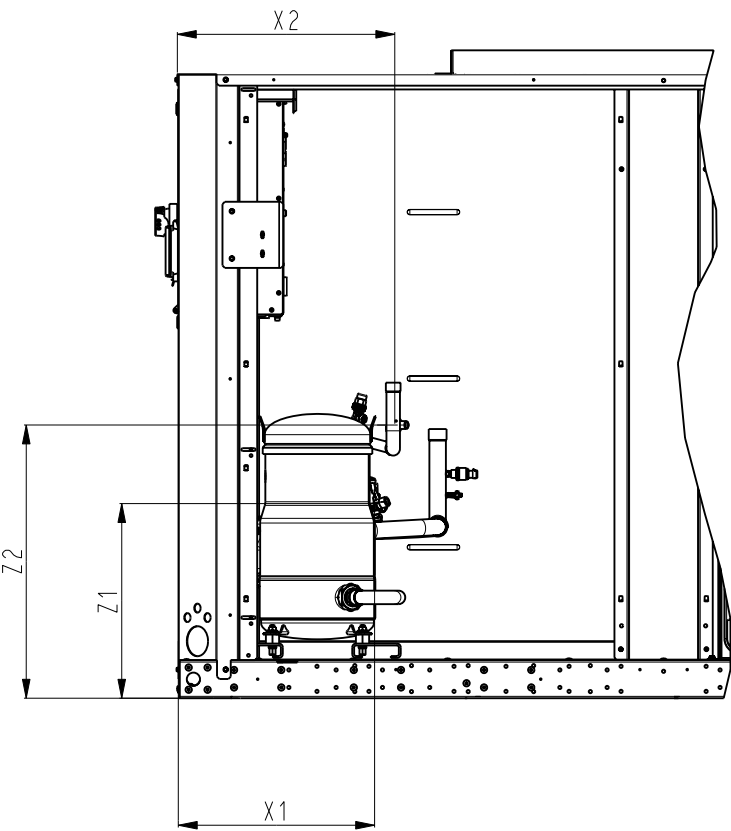


DETAIL D
ECHELLE 11:20

5

30RB UNITS (BP)	40/45 KW	50/55/60/70/80 KW
X1	415	436
Y1	551	564
Z1	395	426




6

30RB UNITS (HP)	40/45 KW	50/55/60/70/80 KW
X2	453	453
Y2	506	506
Z2	565	618

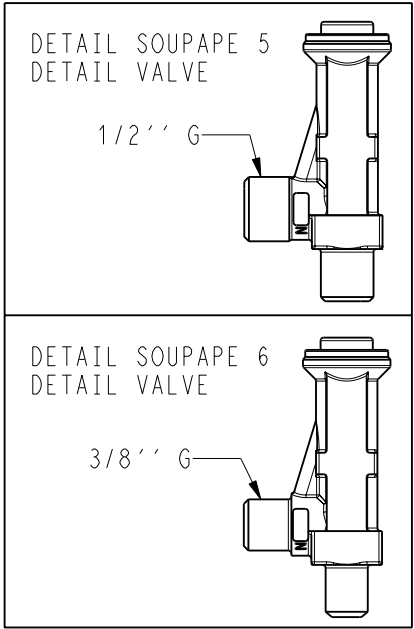



XTRA FAN OPTION INFORMATION

OPTION POUR XTRA FAN*
OPTION FOR XTRA FAN*

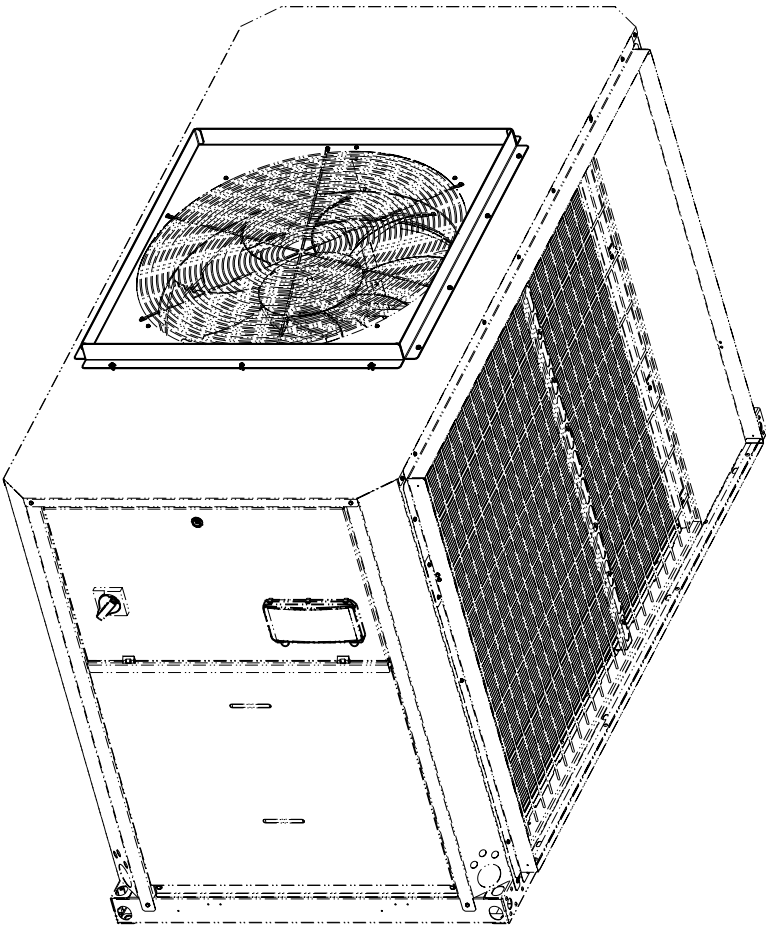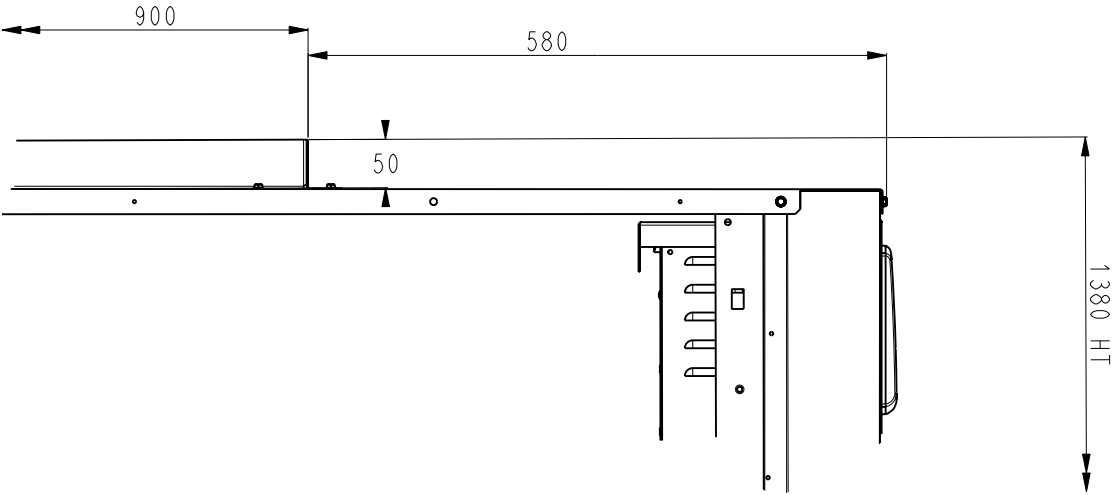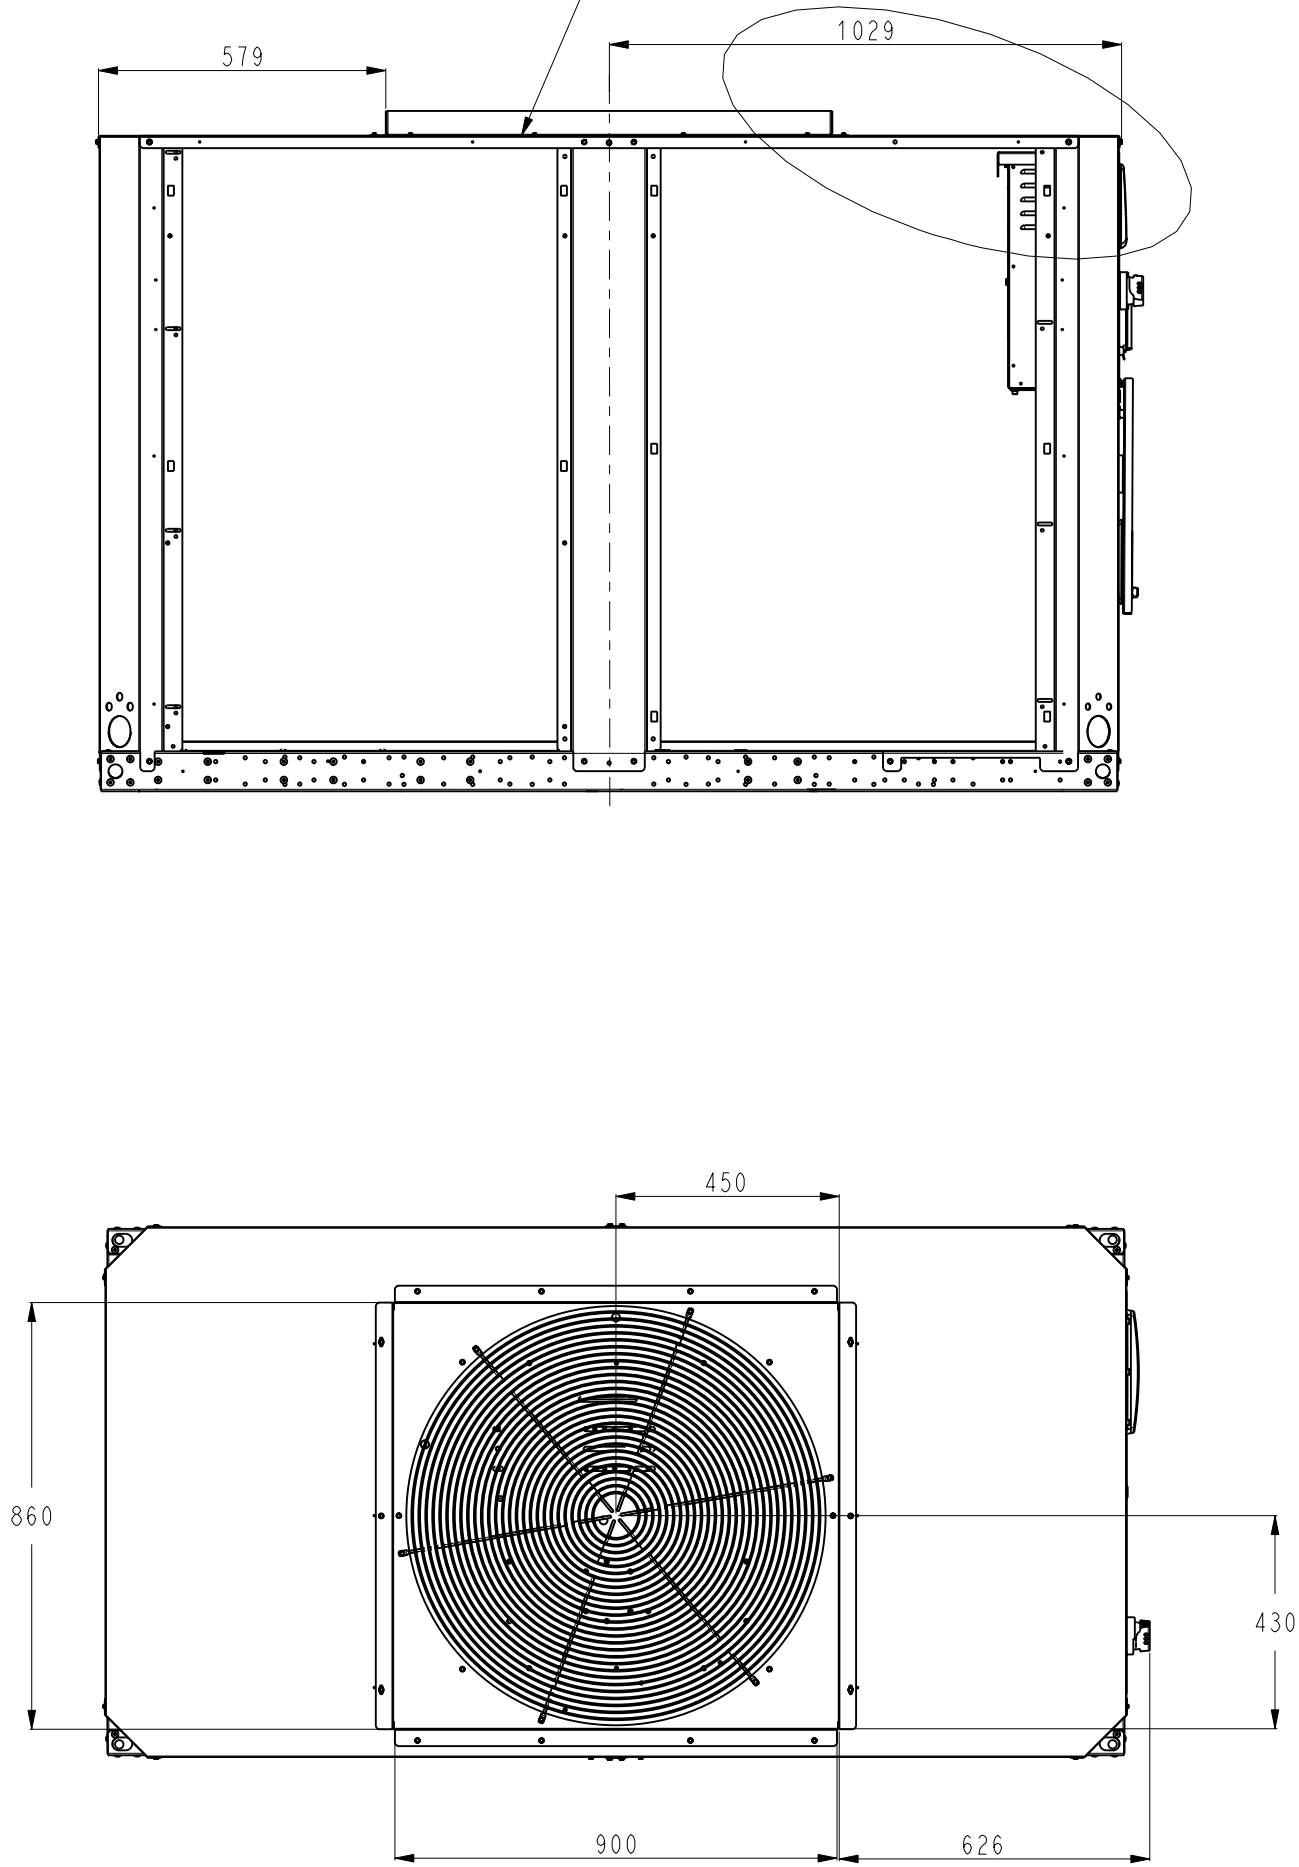



TOLERANCE	30RB 040R-080R	Carrier	DATE	Feuille
±10	*		11-Aug-23	Sheet
		00DCG000393300		5/7
				Indice
				D

OPTION GAINE ASPI AVEC FILTRES
SUCTION AI FILTER CONNECTION FRAME OPTION


















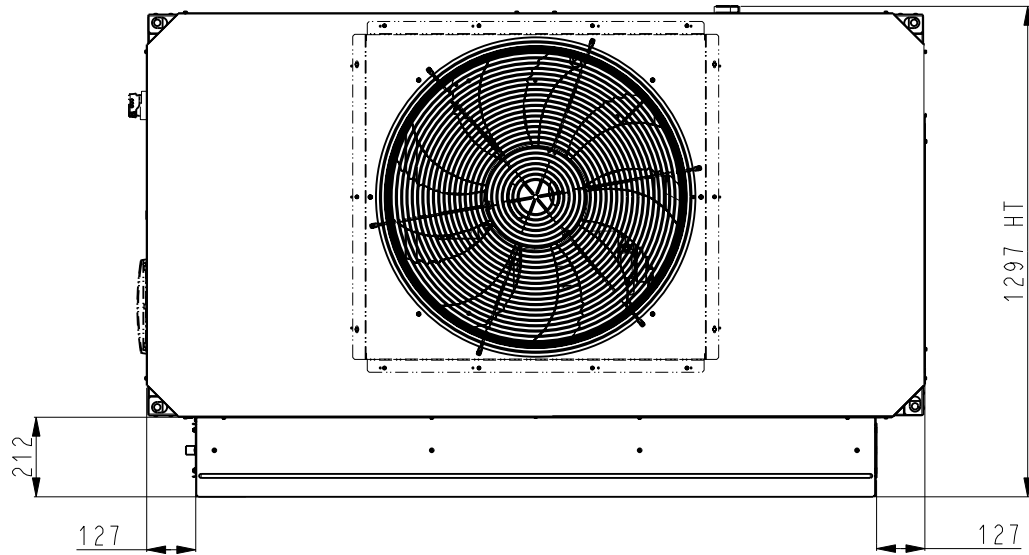
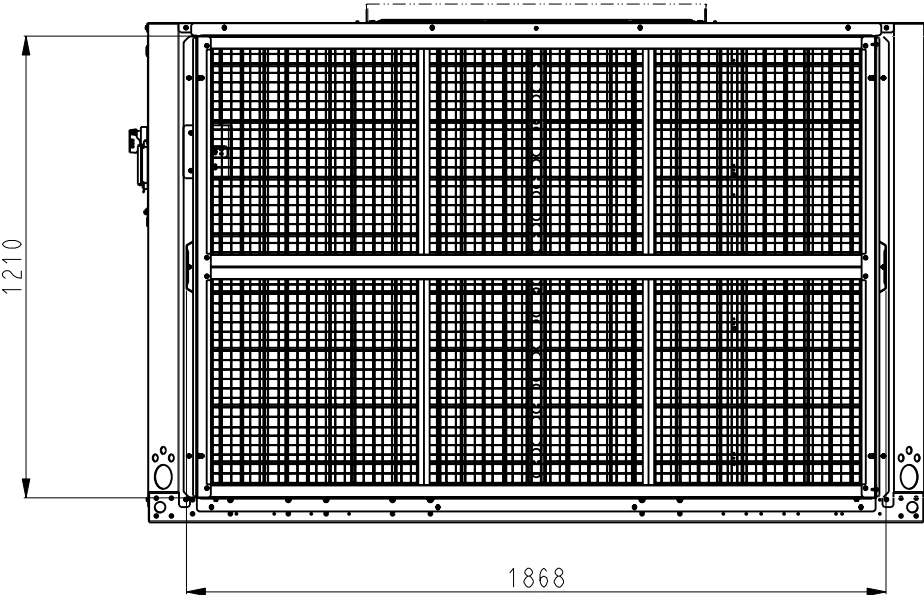


PROFONDEUR DE RACCORDEMENT CLIENT : 50mm
CLIENT CONNECTION DEPTH: 50mm

OPTION GAINE D'ASPIRATION
SUCTION CONNECTION FRAME OPTION

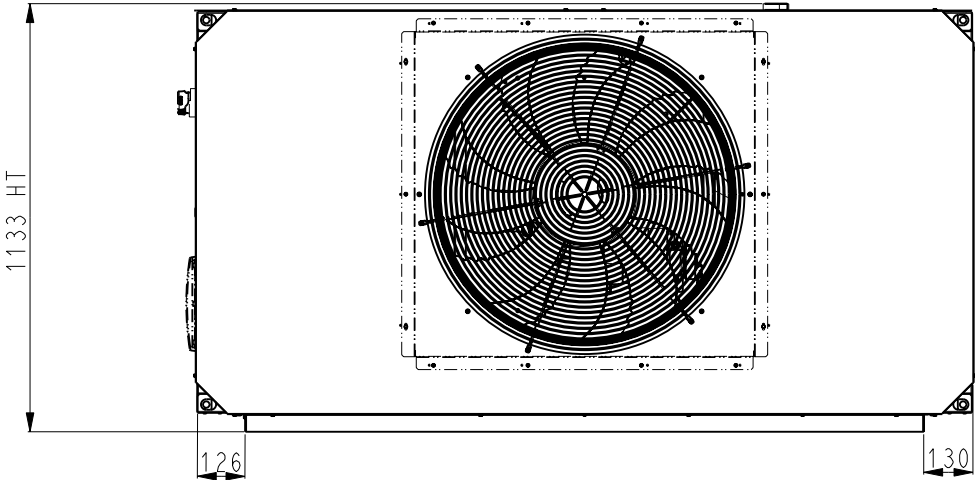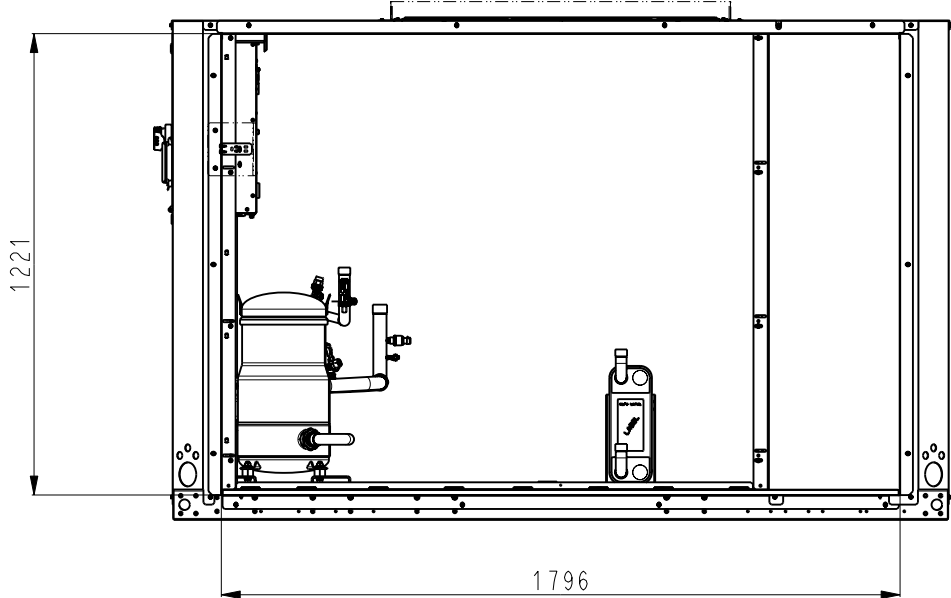

PROFONDEUR DE RACCORDEMENT CLIENT: 50mm
CLIENT CONNECTION DEPTH: 50mm

					00DCG000393300 D
SYMBOLS DESCRIPTIONS					
	ENGLISH	FRANCAIS	DEUTSCHE	ESPANOL	ITALIANO
	Unit water inlet and outlet	Entrée et sortie eau unité	Wasser eintritt und austritt	Entrada y salida agua unidade	Entrata e uscita acqua unita
	Water inlet and outlet OPT 049	Entrée et sortie eau OPT 049	Eintritt und austritt OPT 049	Entrada y salida agua OPT 049	Entrata e uscita acqua OPT 049
	N/A	N/A	N/A	N/A	N/A
	NA	NA	NA	NA	NA
	Safety relief valve LP	Soupape de sécurité BP	Verdampfer sichereitsventil LP	Valvula de seguridad LP	Valvola di sicurezza LP
	Safety relief valve HP	Soupape de sécurité HP	Verdampfer sichereitsventil HP	Valvula de seguridad HP	Valvola di sicurezza HP
	NA	NA	NA	NA	NA
	NA	NA	NA	NA	NA
	NA	NA	NA	NA	NA
	NA	NA	NA	NA	NA
	NA	NA	NA	NA	NA
	NA	NA	NA	NA	NA
	Services clearances required	Espace nécessaire à la maintenance	Freiraum für wartung	Espacio necesario para servicio y mantenimiento	Spazio necessario per il servizio
	NA	NA	NA	NA	NA
	Electrical box	Coffret électrique	Schaltschrank	Caja electrica	Pannello elettrico
	Main disconnect switch	Interrupteur général	Haupttrennschalter	Interruptor de desconexion principal	Sezionatore general
	N/A	N/A	N/A	N/A	N/A
	Power supply unit recommend section wire (see IOM)	Raccordement électrique unité section recommandée (voir IOM)	Hauptelektrische anschluss querschnitt (IOM sehen)	Conexiones electricas unidade section recomendada (ver IOM)	Conezione elettrica de l'unità sezione racomandato(vedi IOM)
	Mass ditribution point	Point de répartition de masse	Massenverteilungspunkt	Punto de distribución masiva	Punto di distribuzione di massa
	Inlet water	Entrée eau	Wasser eintritt	Entrada agua	Entrata acqua
	Outlet water	Sortie eau	Wasser austritt	Salida agua	Uscita acqua
	Electrical supply entry	Entrée raccordement électrique	Strom Anschlüsse	Entrada cables electricos	Entrata cavi alimentazione
	NA	NA	NA	NA	NA
	Center of gravity	Centre de gravité	Maschinenschwerpunkt	Centro de gravedad	Centro di gravita
	Handling Rigging of the unit: the sizing of the rigging or lifting elements is the responsibility of the installer	Manutention de l'unité Le dimensionnement des éléments de manutention ou de levage sont sous la responsabilité du manutentionnaire	Anheben des geräts Der installateur ist für die dimensionierung der hebeelemente verantwortlich	Sostienento de la unidad Las dimensiones de los elementos de sostienento o levantamiento es responsabilidad de instalador	Sollevamento dell'apparechio La responsabilita del dimensionamento degli elementi di sistema di sollevamento e di pertinenza dell'installatore
				TOLERANCE ±10	30RB 040R-080R * 00DCG000393300
					DATE 11-Aug-23
					Feuille Sheet 7/7 Indice D