


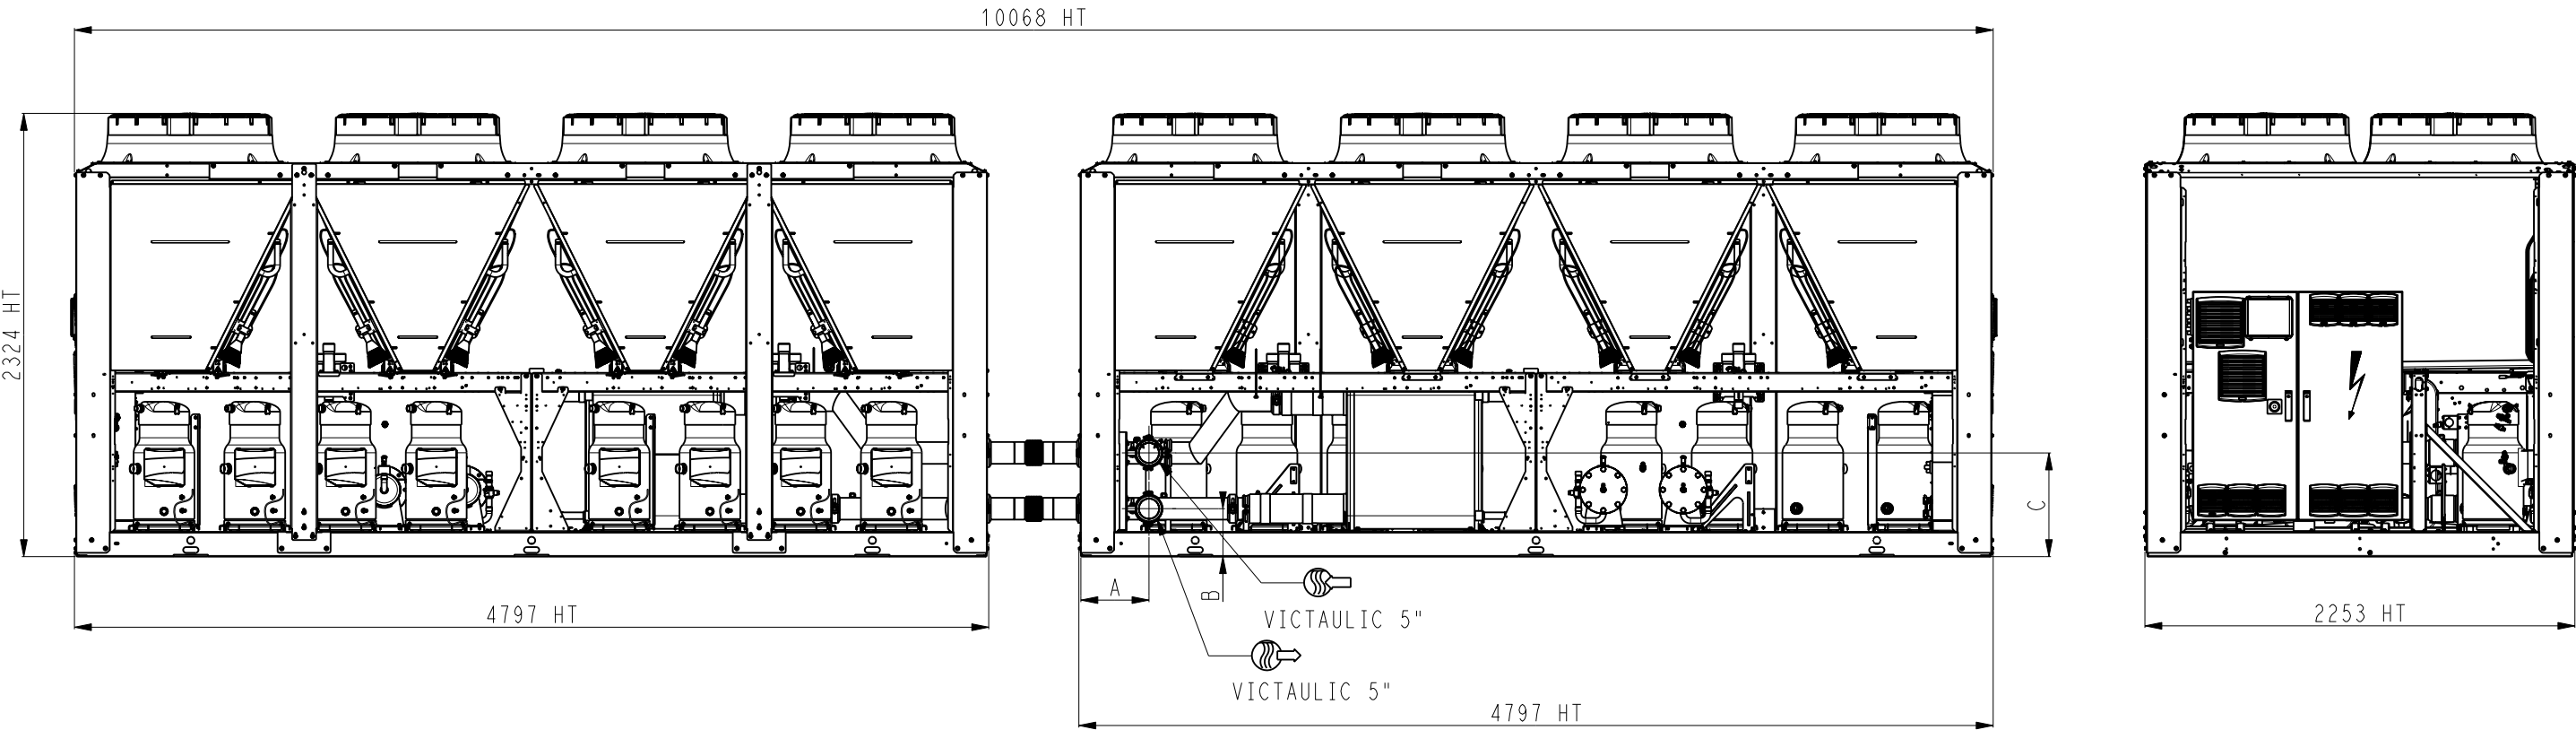


MODULE 2

MODULE 1

* FOR MAINTENANCE, IF THE DISTANCE IS BELOW 500 mm, THE EXTRACTION OF THE FINAL COILS BETWEEN MODULES IS CARRIED OUT BY DISMOUNTING THE ROOF OF COVER OF THE MODULE CORRESPONDING "V" COILS.

30RQP	0860R-0940R-1040R
LONGUEUR A	357
LONGUEUR B	251
LONGUEUR C	544
LONGUEUR D	597

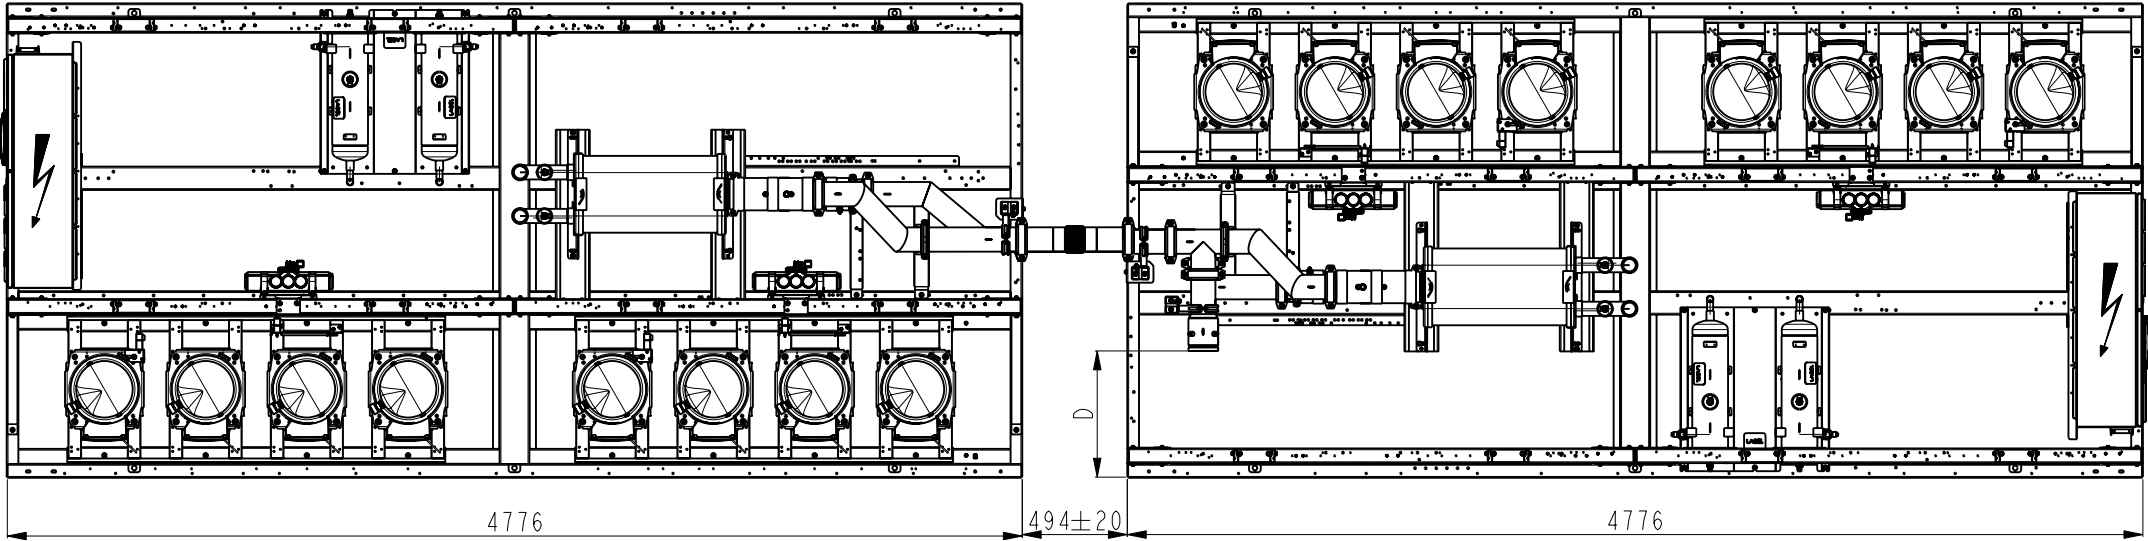

*
SPACE REQUIRED BETWEEN
MODULE 1 AND MODULE 2 FOR
COIL SERVICE



THIS DRAWING REFERS TO THE DETAILS OF WATER CONNECTION
AND FOR MORE DETAILS REFER DIMENSIONAL DRAWING OF EACH UNIT

TOLERANCE	30RQP 0860R-TO-1040R		DATE	Feuille
±10	STD + 325A		20-Sep-2022	Sheet
		00DCG000457500		1/4
				Indice
				B

OPT-49



MODULE 2

MODULE 1

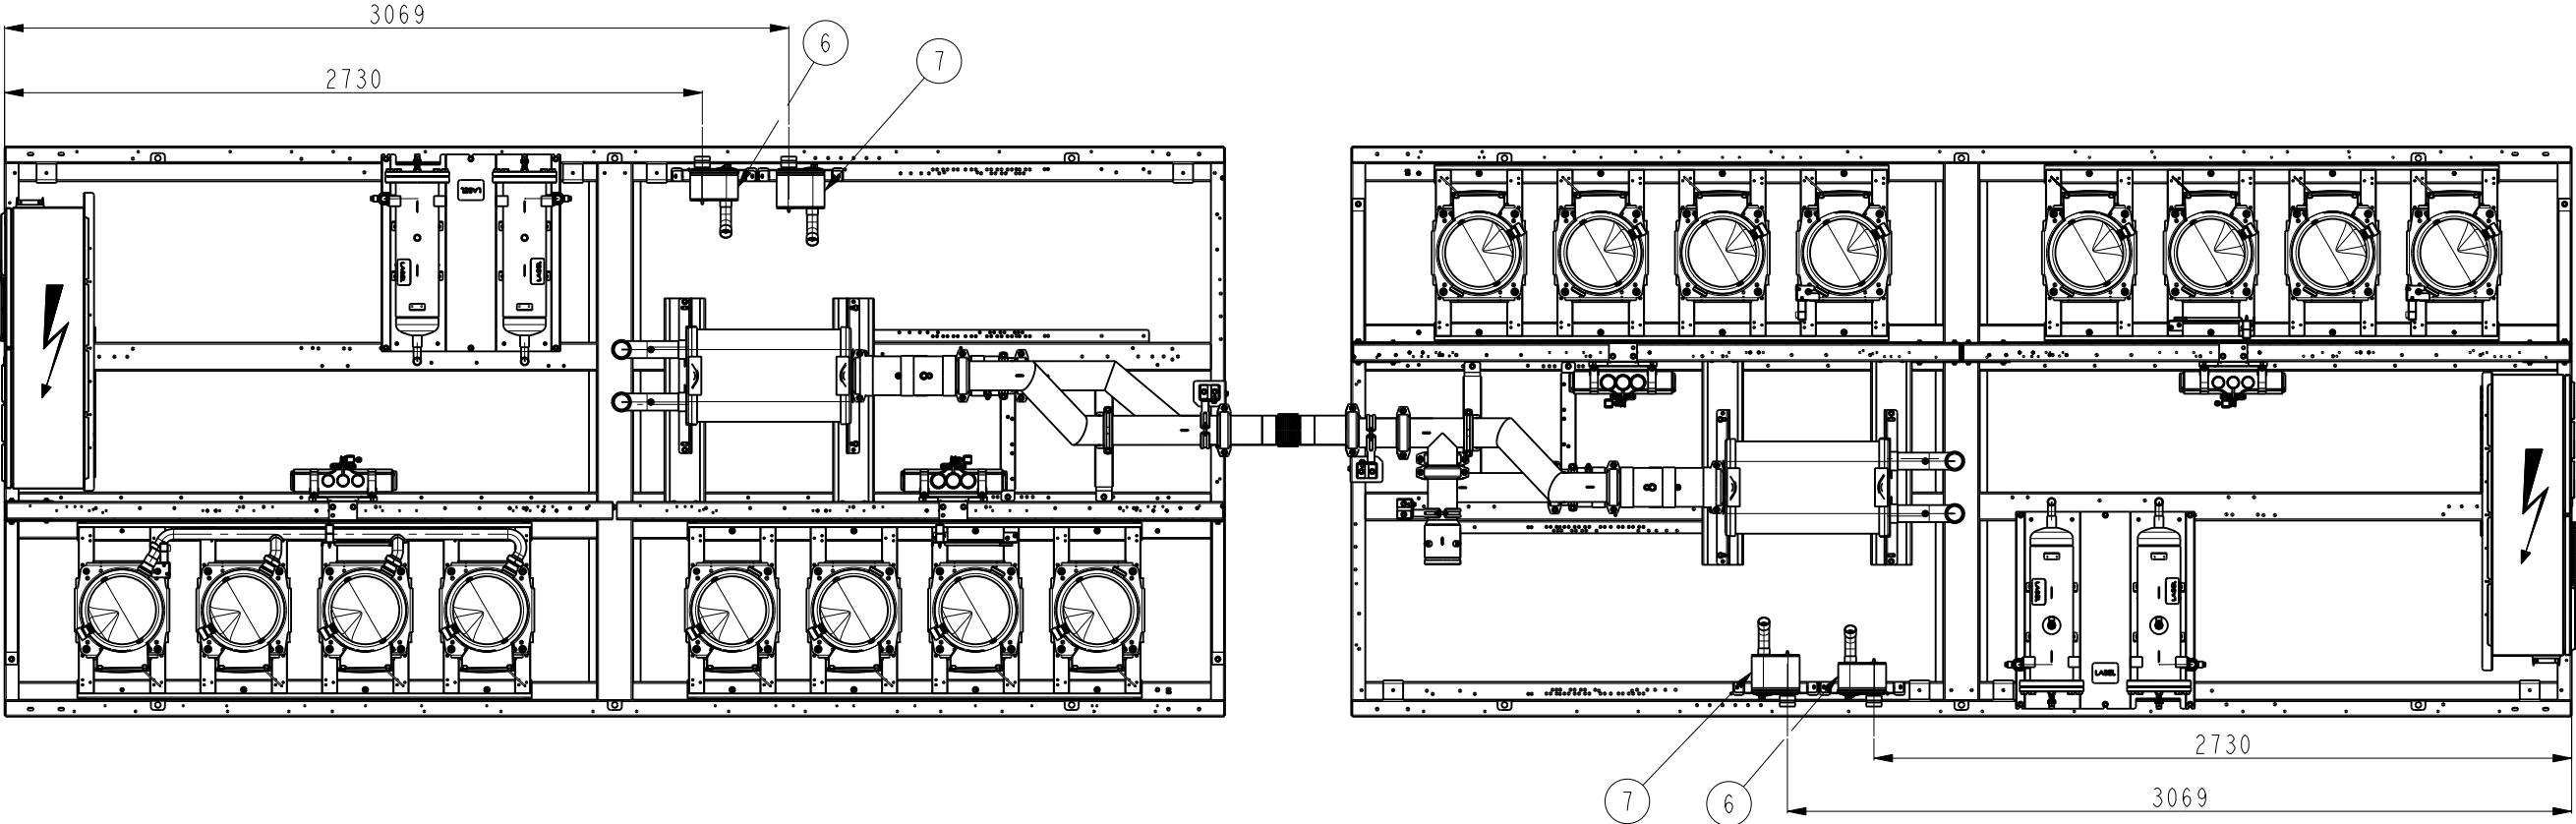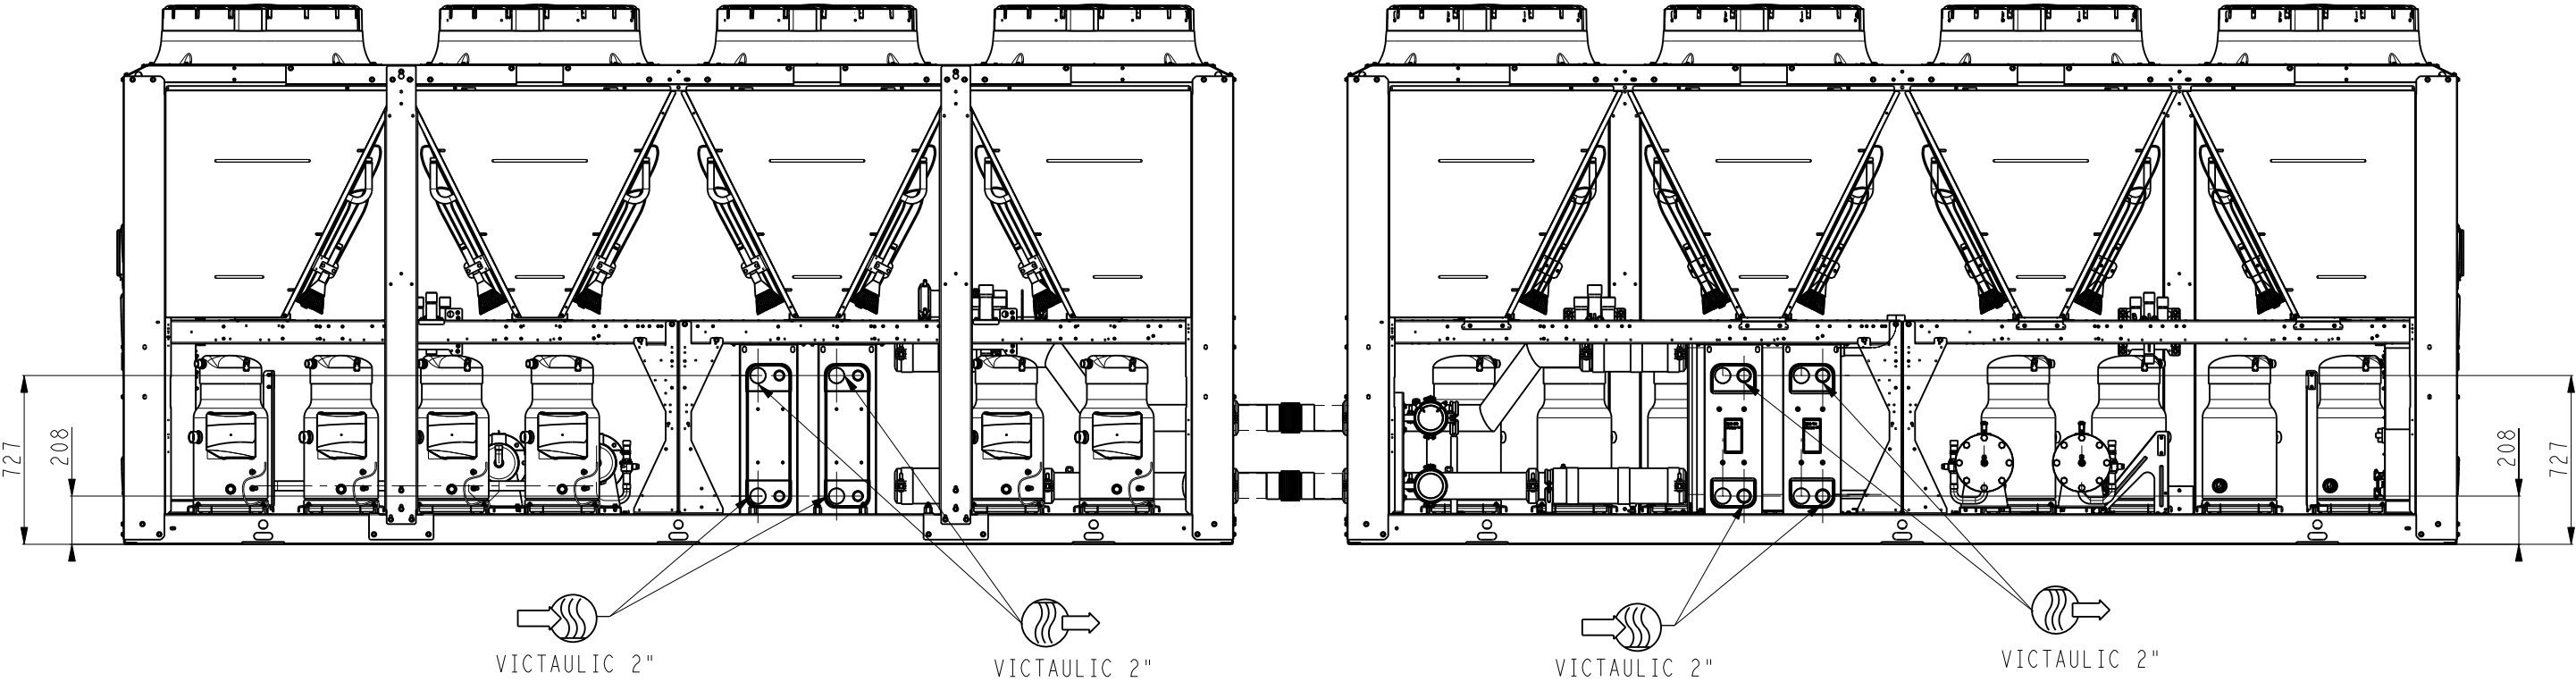

TOLERANCE	30RQP 0860R-T0-1040R	DATE	Feuille
±10	STD + 325A	20-Sep-2022	Sheet
		00DCG000457500	2/4
			Indice
			B

OPT 266

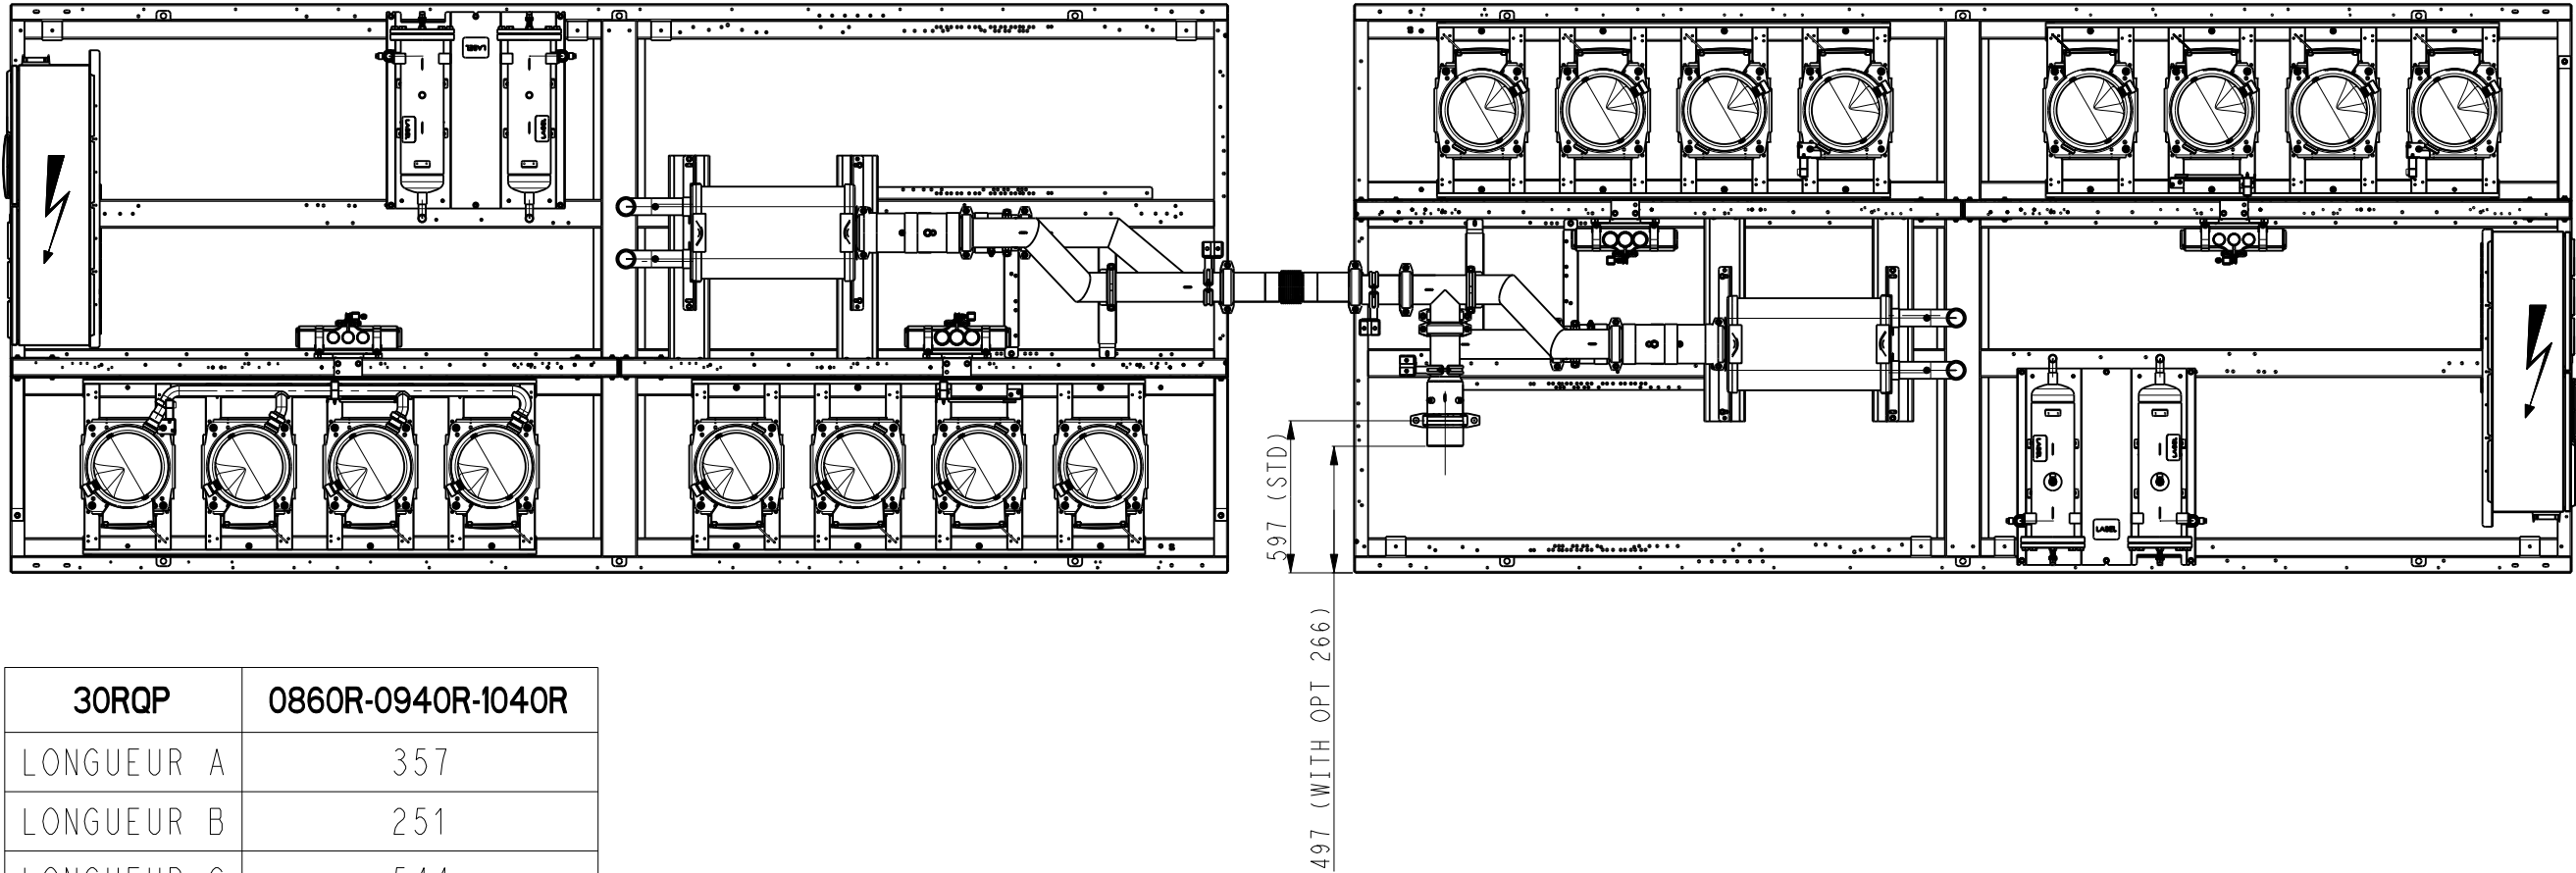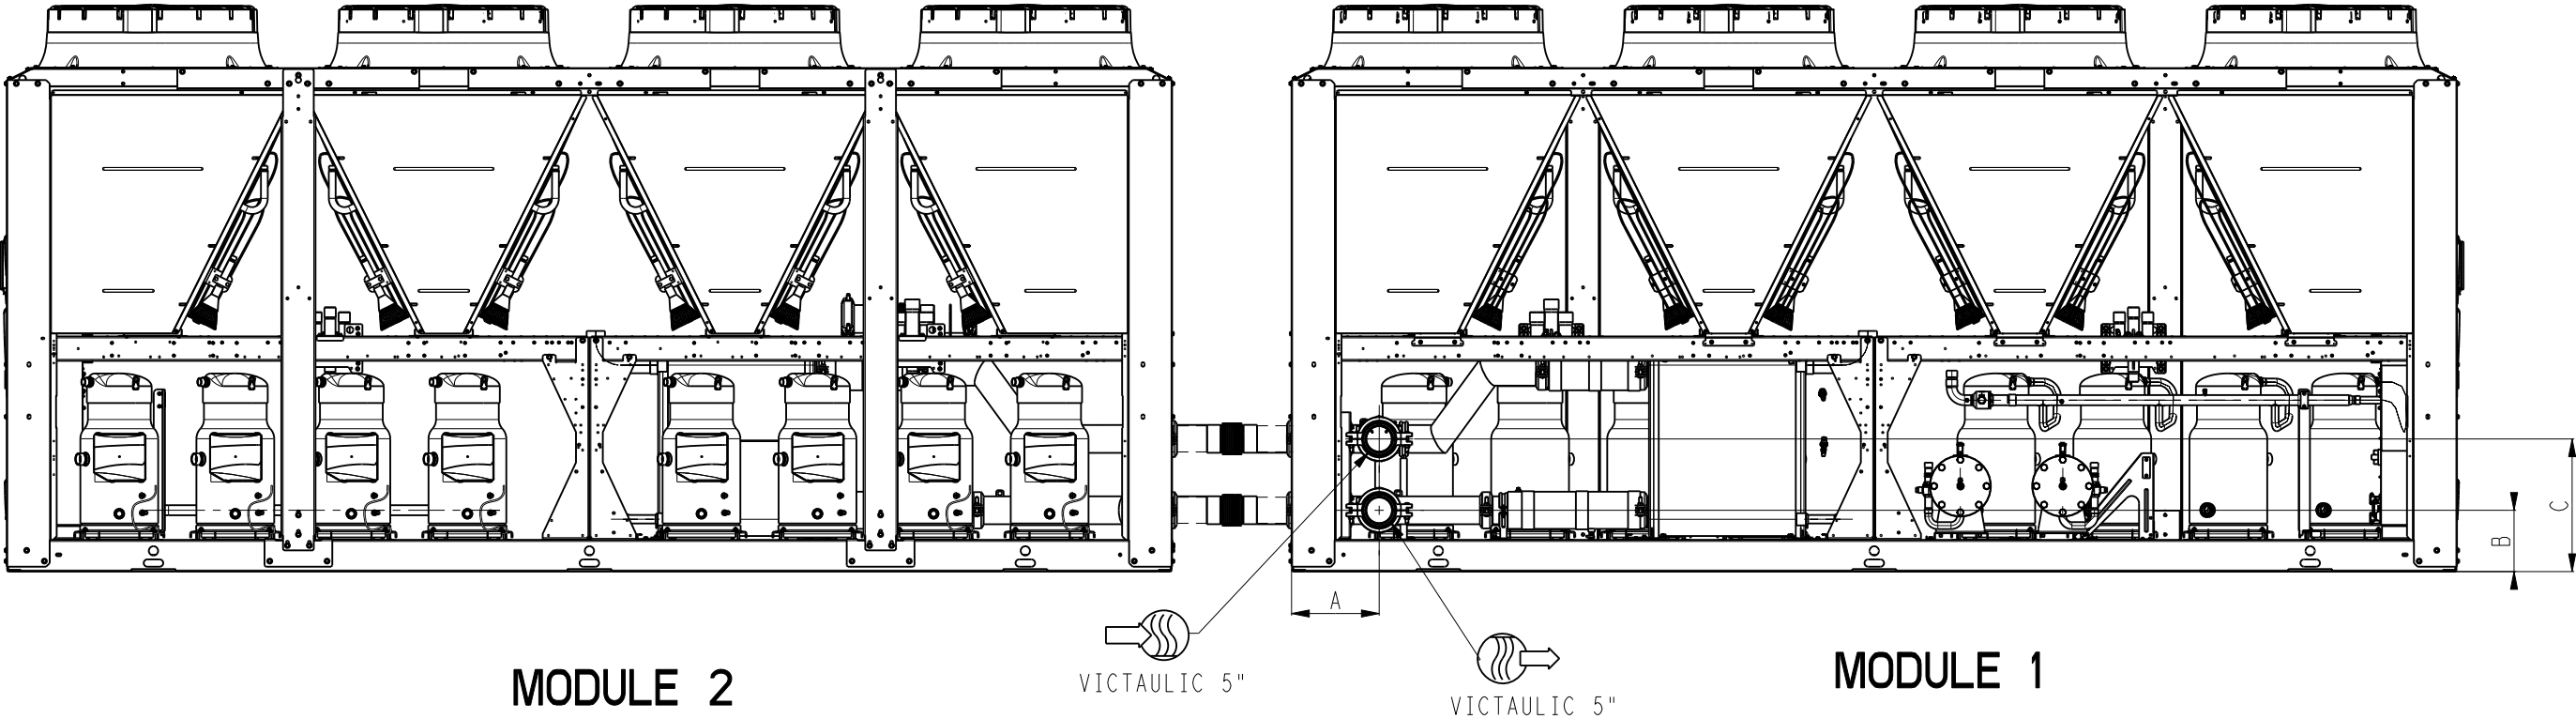

30RQP	0860R-0940R-1040R
LONGUEUR A	357
LONGUEUR B	251
LONGUEUR C	544

	ENGLISH	FRANCAIS	DEUTSCH	ESPANOL	ITALIANO
	Inlet water	Entrée eau	Wasser eintritt	Entrada agua	Entrata acqua
	Outlet water	Sortie eau	Wasser austritt	Salida agua	Uscita acqua
	Desuperheater circuit A water inlet and outlet	Entrée et sortie d'eau désurchauffeur circuit A	Enthitzer Kreislauf A eintritt und austritt	Desrecalentador circuito A entrada y salida agua	Desurriscaldatore Circuito A ingresso e uscita acqua
	Desuperheater circuit B water inlet and outlet	Entrée et sortie d'eau désurchauffeur circuit B	Enthitzer Kreislauf B eintritt und austritt	Desrecalentador circuito B entrada y salida agua	Desurriscaldatore Circuito B ingresso e uscita acqua