





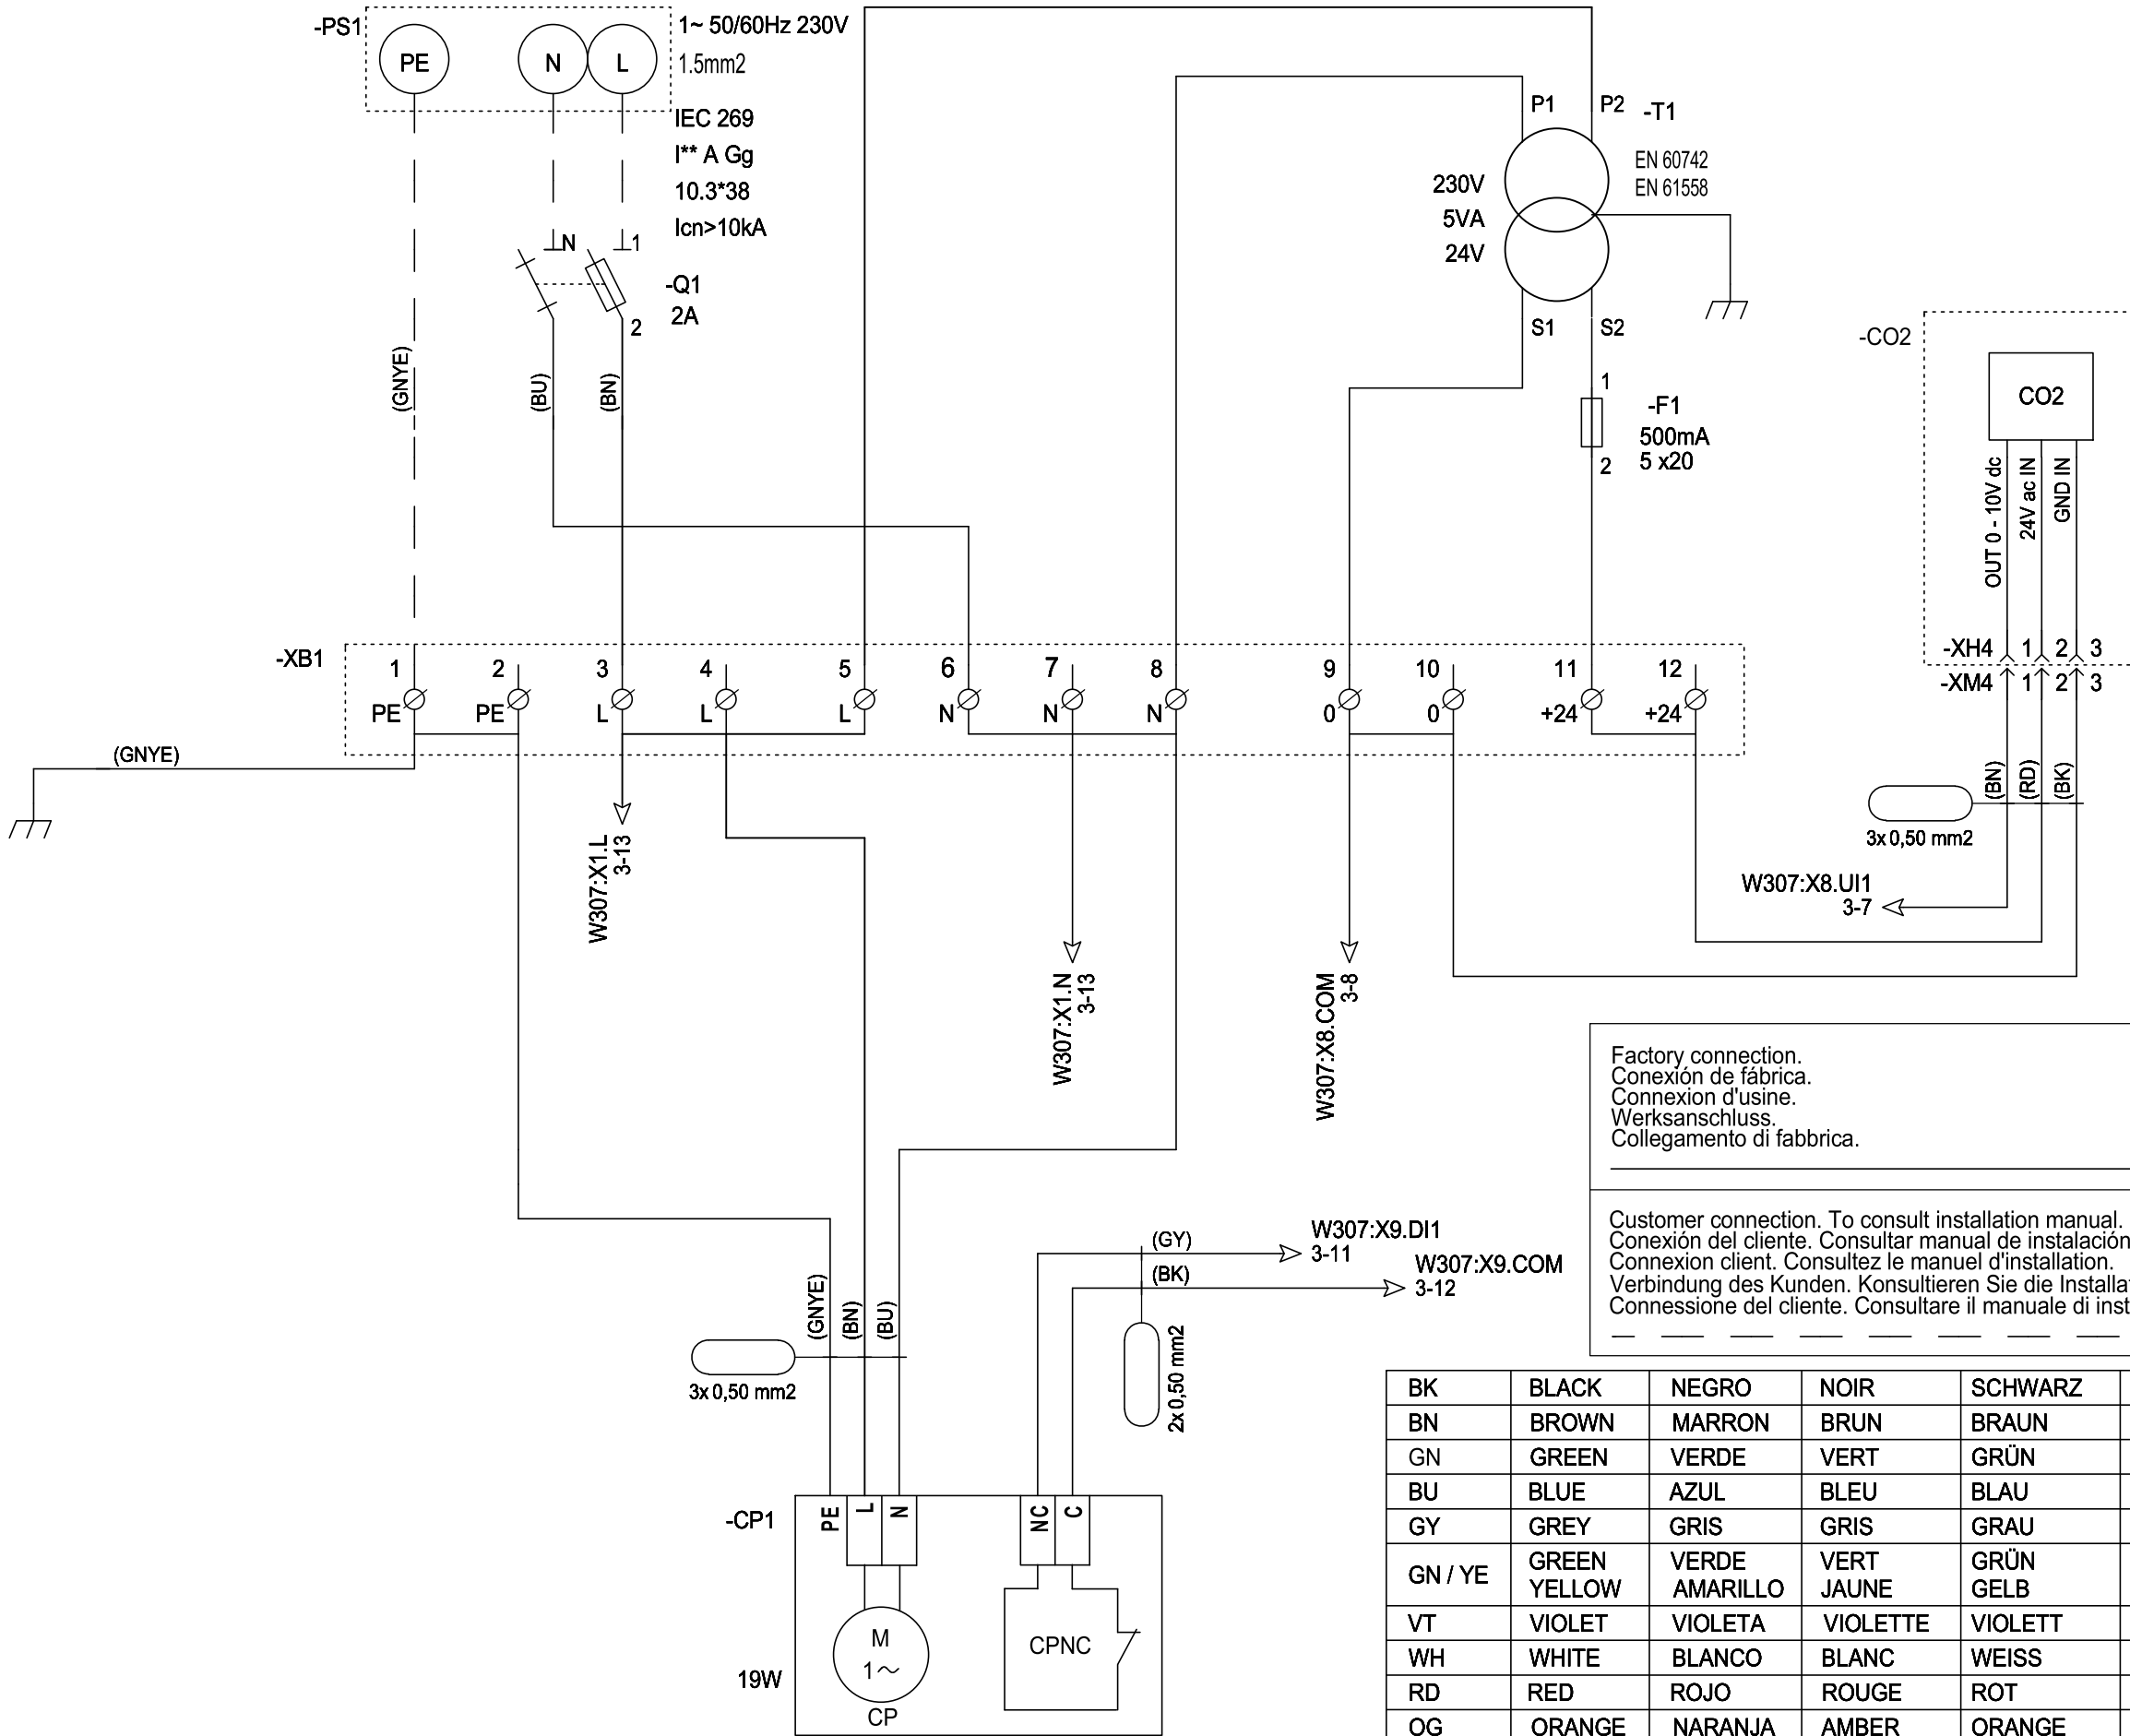

CREADO POR: M.MONTIJANO		FECHA 06/12/2023	REFERENCIA/REFERENCE/REFERENCE/REFERENZ 4 2 N X 3 2 H 0 M 3 0 A P F P 0 A 1	N.P.		FOLIO 3 / 5	
MODIFICADO POR: M.MONTIJANO	REV. A.1	FECHA 20/08/2024		WTC 307B CONTROL - CONTROL WTC 307B - CONTROLE WTC 307B - WTC 307B STEUERUNG - CONTROLLO WTC 307B		REV. A.1	◀ 2 4 ▶
MODIFICACIÓN 00814		TENSION/VOLTAGE/SPANNUNG 230V/1~/50Hz				Programa SEE v. 4.80	
DETAILS. FORMAT UPDATING							

ENGLISH		ESPAÑOL		FRANÇAIS		DEUTSCH		ITALIANO	
-PS1	POWER SUPPLY	-PS1	FUENTE DE ALIMENTACIÓN	-PS1	SOURCE DE COURANT	-PS1	STROMVERSORGUNG	-PS1	ALIMENTAZIONE ELETTRICA
-CUSTOMER	CUSTOMER CONTROL / THERMOSTAT	-CUSTOMER	CONTROL CLIENTE / TERMOSTATO	-CUSTOMER	CONTRÔLE CLIENT / THERMOSTAT	-CUSTOMER	KUNDENSTEUERUNG / THERMOSTAT	-CUSTOMER	CONTROLLO CLIENTE/TERMOSTATO
-Q1	FUSE HOLDER	-Q1	PORTAFUSIBLE	-Q1	PORTE-FUSIBLE	-Q1	SICHERUNGSHALTER	-Q1	PORTAFUSIBILI
-XB1	TERMINAL BLOCK	-XB1	BORNERO	-XB1	BORNIER	-XB1	KLEMMENBLOCK	-XB1	MORSETTIERA
-CV1	COLD WATER VALVE ACTUATOR	-CV1	ACTUADOR VÁLVULA DE AGUA FRÍA	-CV1	ACTIONNEUR DE LA VANNE D'EAU FROIDE	-CV1	KALTWASSERVENTILSTELLANTRIEB	-CV1	ATTUATORE VALVOLA ACQUA FREDDA
-CP1	CONDENSATE PUMP	-CP1	BOMBA DE CONDENSADOS	-CP1	POMPE À CONDENSAT	-CP1	KONDENSATPUMPE	-CP1	POMPA CONDENSA
-M1	LOW CONSUMPTION EC MOTOR	-M1	MOTOR DE BAJO CONSUMO EC	-M1	MOTEUR EC BASSE CONSOMMATION	-M1	EC-MOTOR MIT GERINGEM VERBRAUCH	-M1	MOTORE EC A BASSO CONSUMO
-EMC	EMC FILTER	-EMC	FILTRO EMC	-EMC	FILTRE CEM	-EMC	EMV-FILTER	-EMC	FILTRO EMC
-RAS1	RETURN AIR TEMPERATURE SENSOR	-RAS1	SENSOR DE TEMPERATURA DE AIRE DE RETORNO	-RAS1	SONDE DE TEMPÉRATURE D'AIR DE RETOUR	-RAS1	RÜCKLUFTTEMPERATURSENSOR	-RAS1	SENSORE TEMPERATURA ARIA DI RITORNO
-SAS1	SUPPLY AIR TEMPERATURE SENSOR	-SAS1	SENSOR DE TEMPERATURA DE AIRE DE SUMINISTRO	-SAS1	SONDE DE TEMPÉRATURE D'AIR SOUFFLÉ	-SAS1	ZULUFTTEMPERATURSENSOR	-SAS1	SENSORE TEMPERATURA ARIA DI MANDATA
-CO2	CO2 SENSOR	-CO2	SENSOR DE CO2	-CO2	SONDE DE CO2	-CO2	CO2-SENSOR	-CO2	SENSORE DI CO2
-T1	TRANSFORMER	-T1	TRANSFORMADOR	-T1	TRANSFORMATEUR	-T1	TRANSFORMATOR	-T1	TRASFORMATORE
-FU1	FUSE	-FU1	FUSIBLE	-FU1	FUSIBLE	-FU1	SICHERUNG	-FU1	FUSIBILE
-XH4 / -XM4	CONNECTOR 4	-XH4 / -XM4	CONECTOR 4	-XH4 / -XM4	CONNECTEUR 4	-XH4 / -XM4	VERBINDER 4	-XH4 / -XM4	CONNETTORE 4
-WTC307	WTC 307 BACNET CONTROL	-WTC307	CONTROL WTC 307 BACNET	-WTC307	CONTRÔLE WTC 307 BACNET	-WTC307	WTC 307 BACNET-STEUERUNG	-WTC307	CONTROLLO WTC 307 BACNET

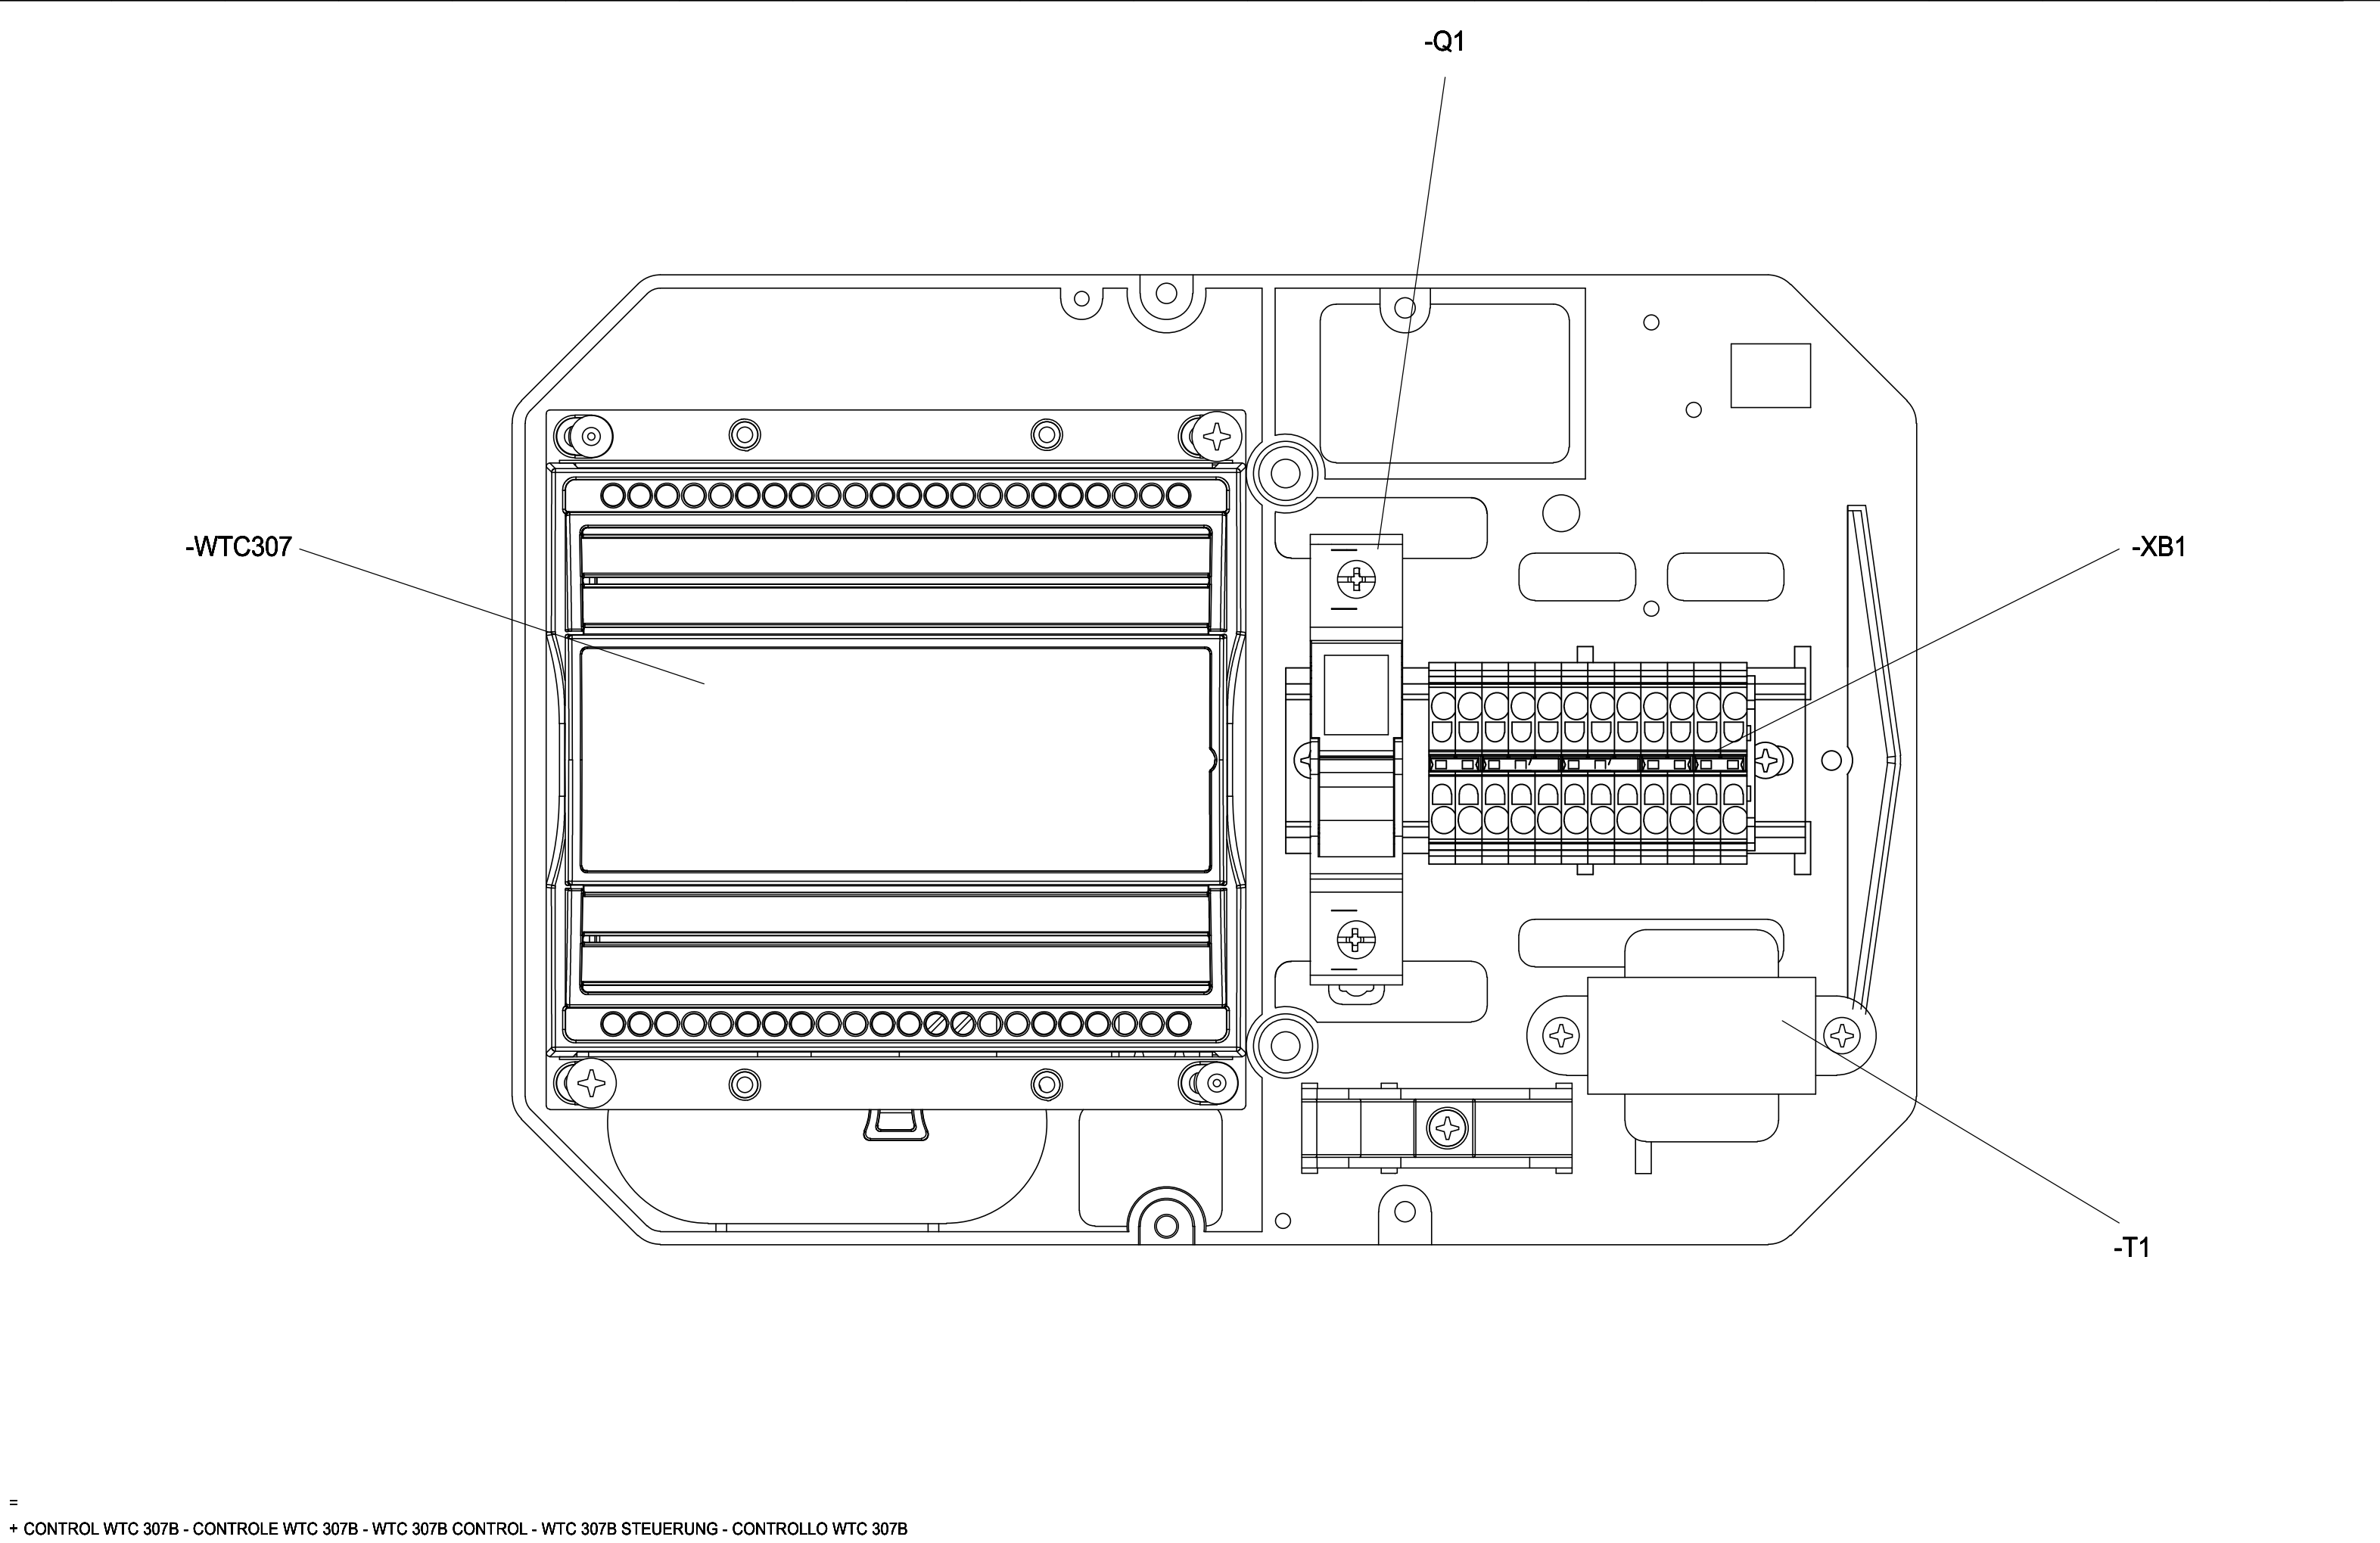

=
+ CONTROL WTC 307B - CONTROLE WTC 307B - WTC 307B CONTROL - WTC 307B STEUERUNG - CONTROLLO WTC 307B

CREADO POR: M.MONTIJANO		FECHA 06/12/2023	REFERENCIA/REFERENCE/REFERENCE/REFERENZ 4 2 N X 3 2 H 0 M 3 0 A P F P 0 A 1			N.P.	FOLIO 5 / 5
MODIFICADO POR: M.MONTIJANO	REV. A.1	FECHA 20/08/2024		IMPLANTATION - IMPLANTACIÓN - IMPIANTO			
MODIFICACIÓN DETAILS. FORMAT UPDATING		00814		TENSION/VOLTAGE/SPANNUNG 230V/1~/50Hz		REV. A.1	