

Revit Family file

30RQ-090R-TO-120R

30RQ-090R-TO-120R FAMILY TABLE OPTIONS

Family Types

Type name: 30RQ-090R





30RQ-090R

Search param 30RQ-100R





30RQ-120R

Parameter	Value
Construction	
Opt 12	☒
Opt 264	☒
Opt 266	☒
Opt-49	☒
Service Area	☒
Opt 307	☒
Standard	☒
Opt 23	☒
Opt 293	☒
Opt 116S/116U/116W/116Y	☒
Opt 116R/116T/116V/116X	☒
Service Area with Buffer tank	☒

30RQ-090R-TO-120R (Standard)

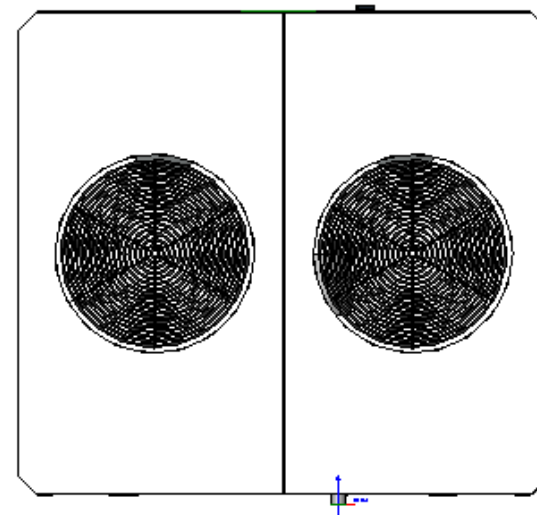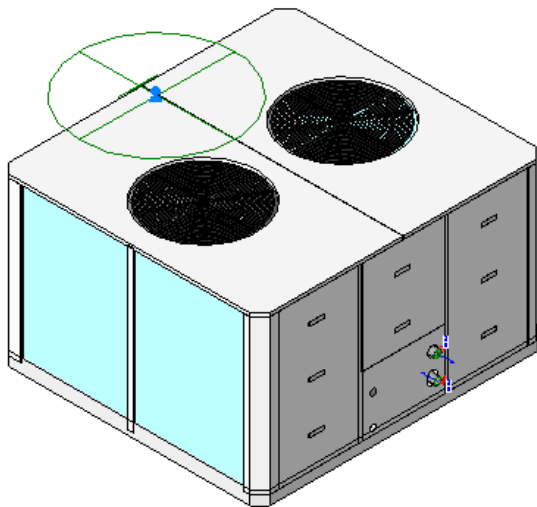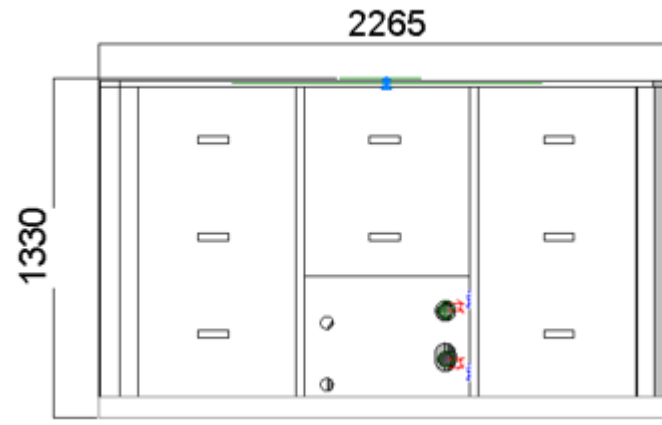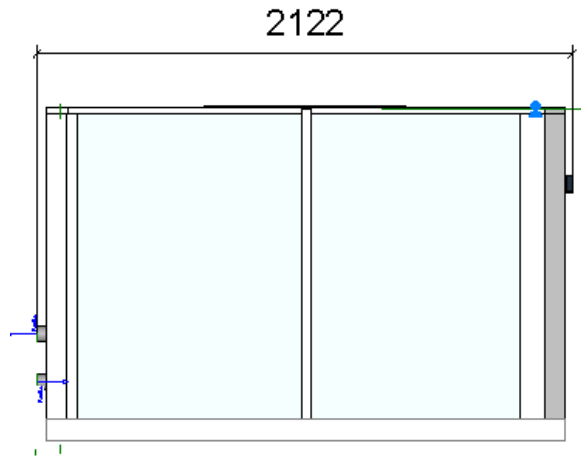


30RQ-090R-TO-120R (Standard with Buffer tank)

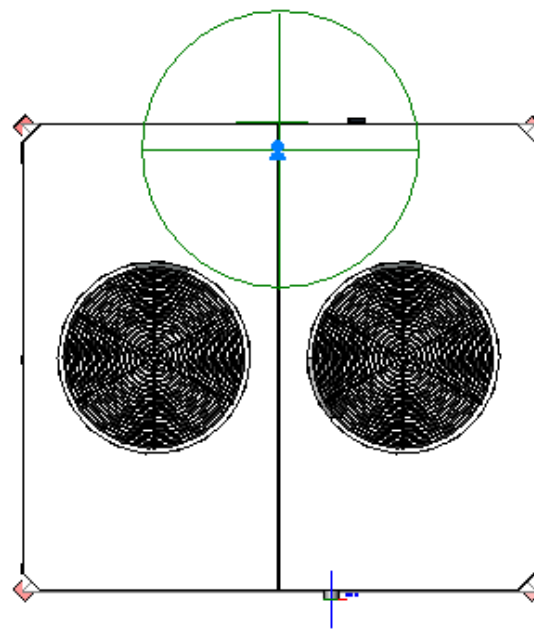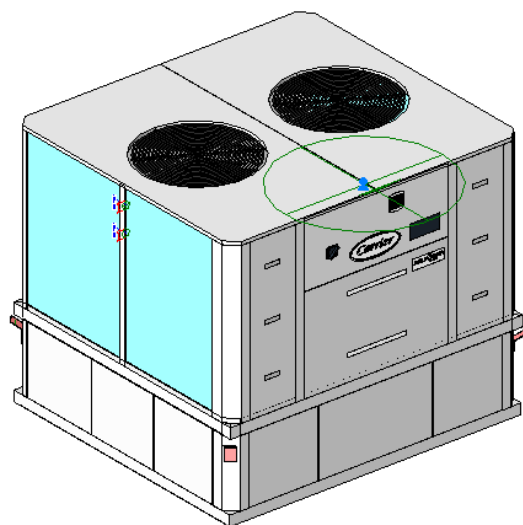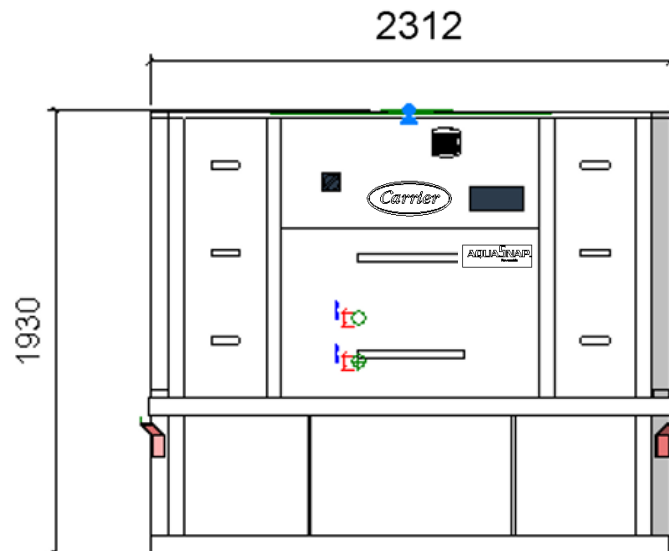
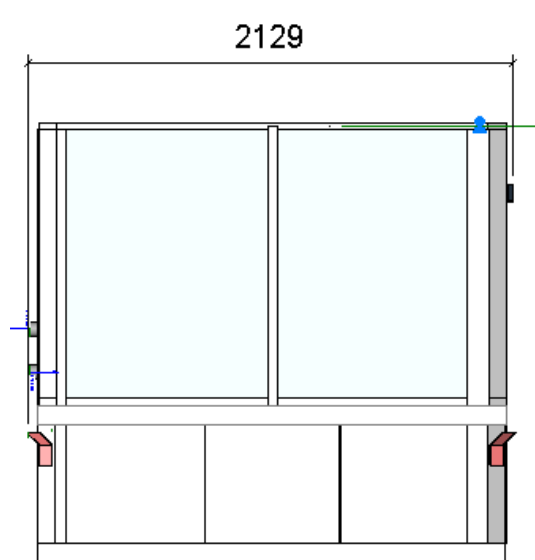


30RQ-090R-TO-120R (Buffer tank)

Construction	
Opt 12	☐
Opt 264	☐
Opt 266	☐
Opt-49	☐
Service Area	☐
Opt 307	☒
Standard	☐
Opt 23	☐
Opt 293	☐
Opt 116S/116U/116W/116Y	☐
Opt 116R/116T/116V/116X	☐
Service Area with Buffer tank	☐

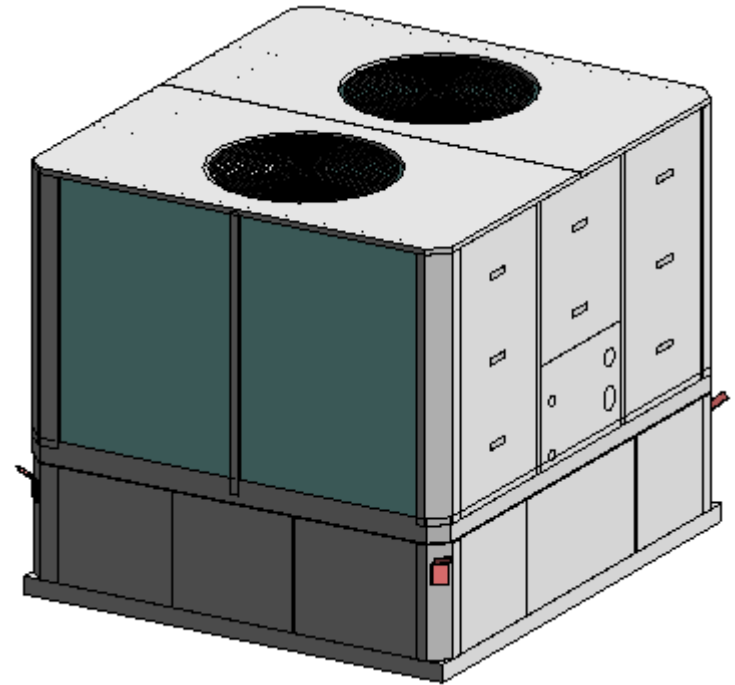

30RQ-090R-TO-120R (Unit Water Connection details)

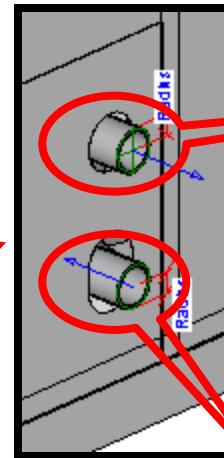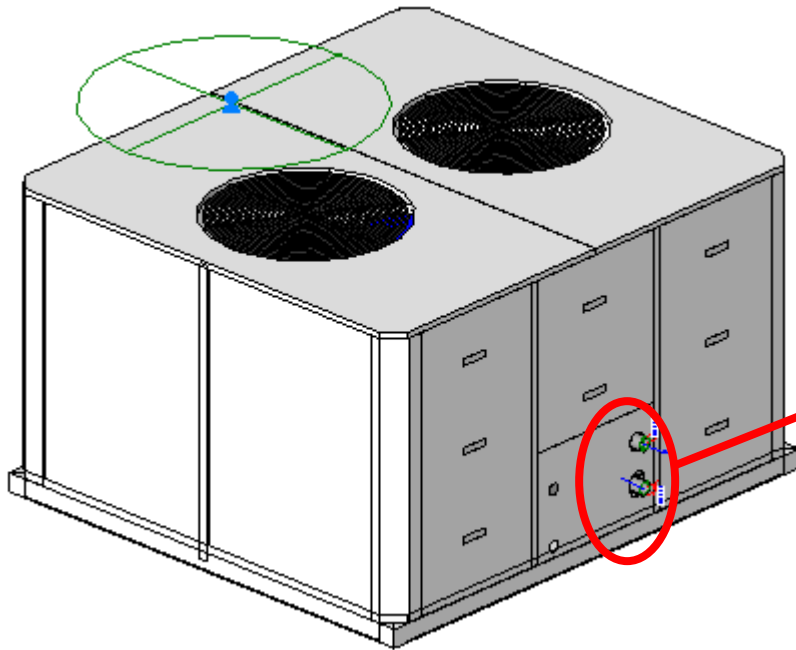

Connector Element (1) Edit Type

Dimensions ^

Diameter 60.3

Mechanical ^

K Coefficient 0.000000

Flow Factor 0.000000

Flow Configur... Calculated

Flow Direction Out

Loss Method Not Defined

Allow Slope Adj... ☐

System Classific... Domestic Cold ...

Mechanical - Flow ^

Fixture Units 0.000000

Flow 0.00 L/s

Pressure Drop 0.00 Pa

Identity Data ^

Utility ☐

Connector Desc... OUTLET

Connector Element (1) Edit Type

Dimensions ^

Diameter 60.3

Mechanical ^

K Coefficient 0.000000

Flow Factor 0.000000

Flow Configur... Calculated

Flow Direction In

Loss Method Not Defined

Allow Slope Adj... ☐

System Classific... Domestic Hot W...

Mechanical - Flow ^

Fixture Units 0.000000

Flow 0.00 L/s

Pressure Drop 0.00 Pa



Identity Data ^

Utility ☐

Connector Desc... INLET

Construction	
Opt 12	☐
Opt 264	☐
Opt 266	☐
Opt-49	☐
Service Area	☐
Opt 307	☐
Standard	☒
Opt 23	☐
Opt 293	☐
Opt 116S/116U/116W/116V	☐
Opt 116R/116T/116V/116X	☐
Service Area with Buffer tank	☐

30RQ-090R-TO-120R (Desuperheater Water Connection details)

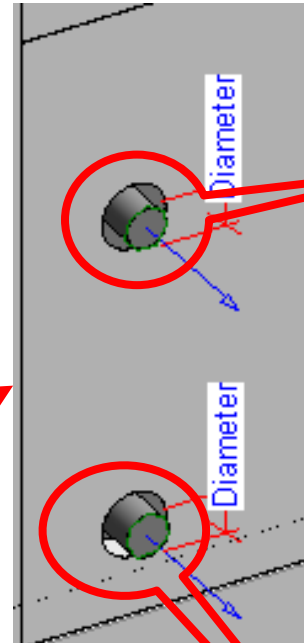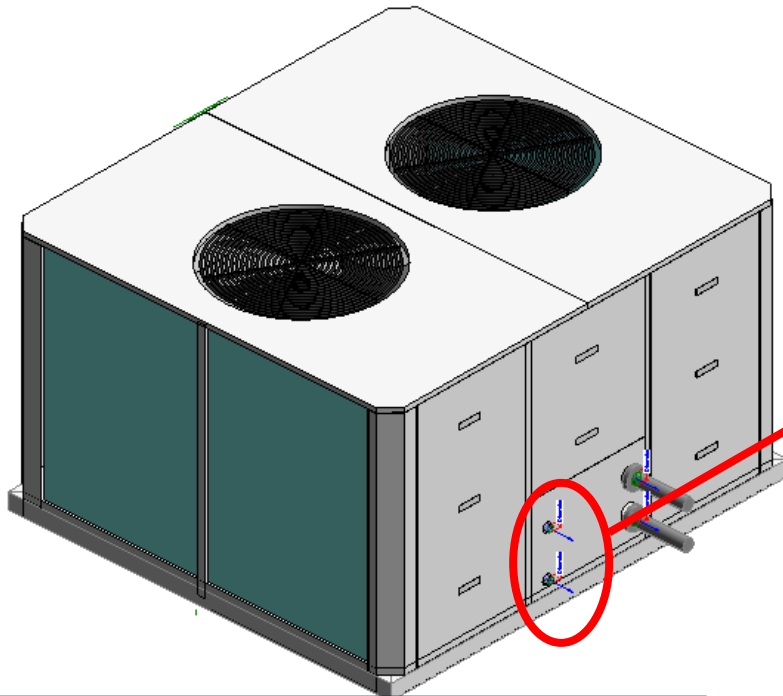


Connector Element (1)		Edit Type
Dimensions		
Diameter	33.2	
Mechanical		
K Coefficient	0.000000	
Flow Factor	0.000000	
Flow Configuration	Calculated	
Flow Direction	Out	
Loss Method	Not Defined	
Allow Slope Adjustments	☐	
System Classification	Domestic Hot Water	
Mechanical - Flow		
Fixture Units	0.000000	
Flow	0.00 L/s	
Pressure Drop	0.00 Pa	
Identity Data		
Utility	☐	
Connector Description	OUTLET	

Connector Element (1)		Edit Type
Dimensions		
Diameter	33.2	
Mechanical		
K Coefficient	0.000000	
Flow Factor	0.000000	
Flow Configuration	Calculated	
Flow Direction	In	
Loss Method	Not Defined	
Allow Slope Adjustments	☐	
System Classification	Domestic Cold Water	
Mechanical - Flow		
Fixture Units	0.000000	
Flow	0.00 L/s	
Pressure Drop	0.00 Pa	
Identity Data		
Utility	☐	
Connector Description	INLET	

Construction	
Opt 12	☐
Opt 264	☐
Opt 266	☐
Opt-49	☒
Service Area	☐
Opt 307	☐
Standard	☐
Opt 23	☐
Opt 293	☐
Opt 116S/116U/116W/116Y	☐
Opt 116R/116T/116V/116X	☐
Service Area with Buffer tank	☐


30RQ-090R-TO-120R (Grilles)

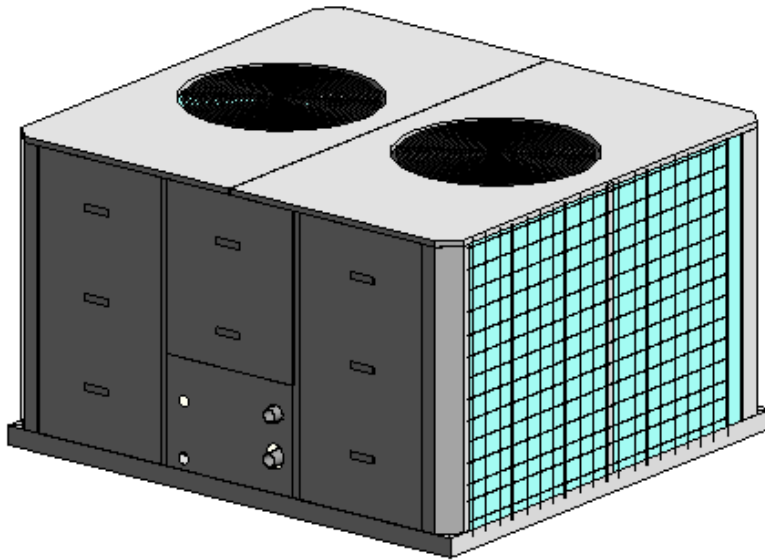

Construction	
Opt 12	☐
Opt 264	☐
Opt 266	☐
Opt-49	☐
Service Area	☐
Opt 307	☐
Standard	☒
Opt 23	☒
Opt 293	☐
Opt 116S/116U/116W/116Y	☐
Opt 116R/116T/116V/116X	☐
Service Area with Buffer tank	☐


30RQ-090R-TO-120R (Single Pump Hydronic with Expansion tank)

Construction	
Opt 12	☐
Opt 264	☐
Opt 266	☐
Opt-49	☐
Service Area	☐
Opt 307	☐
Standard	☒
Opt 23	☐
Opt 293	☒
Opt 116S/116U/116W/116Y	☐
Opt 116R/116T/116V/116X	☒
Service Area with Buffer tank	☐

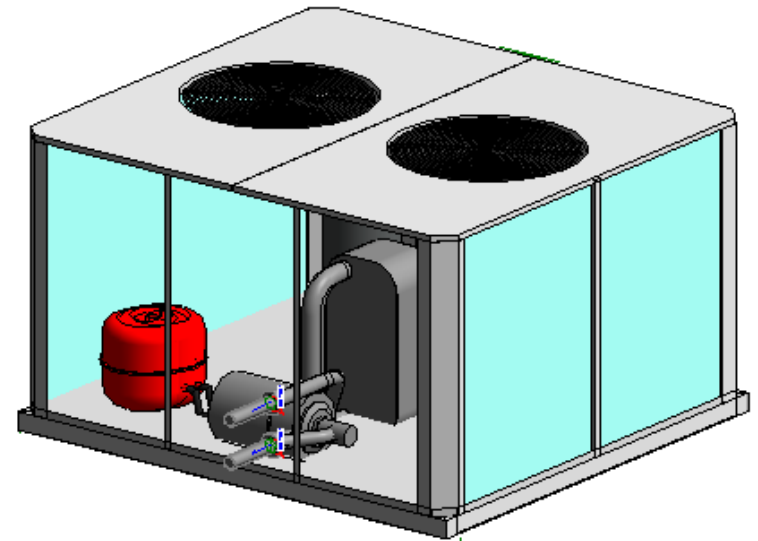


30RQ-090R-TO-120R (Double Pump Hydronic with Expansion tank)

Construction	
Opt 12	☐
Opt 264	☐
Opt 266	☐
Opt-49	☐
Service Area	☐
Opt 307	☐
Standard	☒
Opt 23	☐
Opt 293	☒
Opt 116S/116U/116W/116Y	☒
Opt 116R/116T/116V/116X	☐
Service Area with Buffer tank	☐

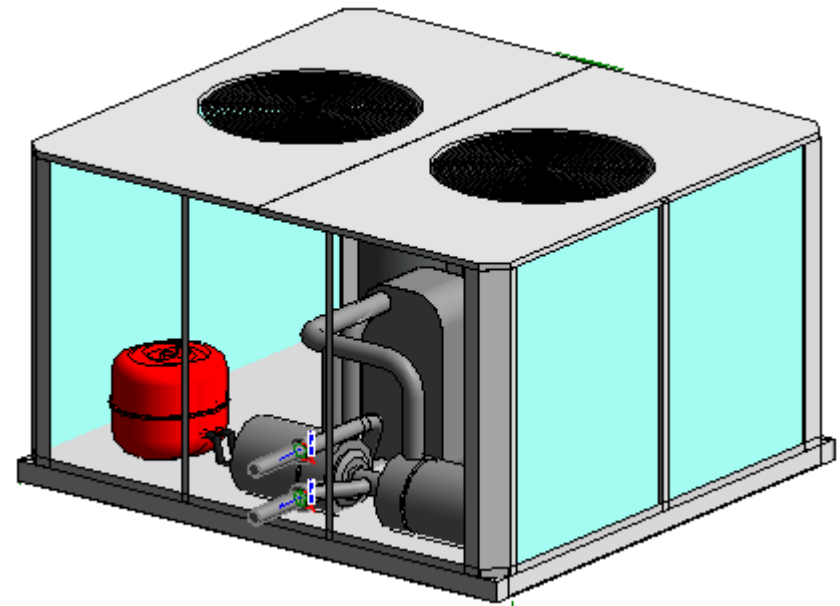


30RQ-090R-TO-120R (Desuperheater)

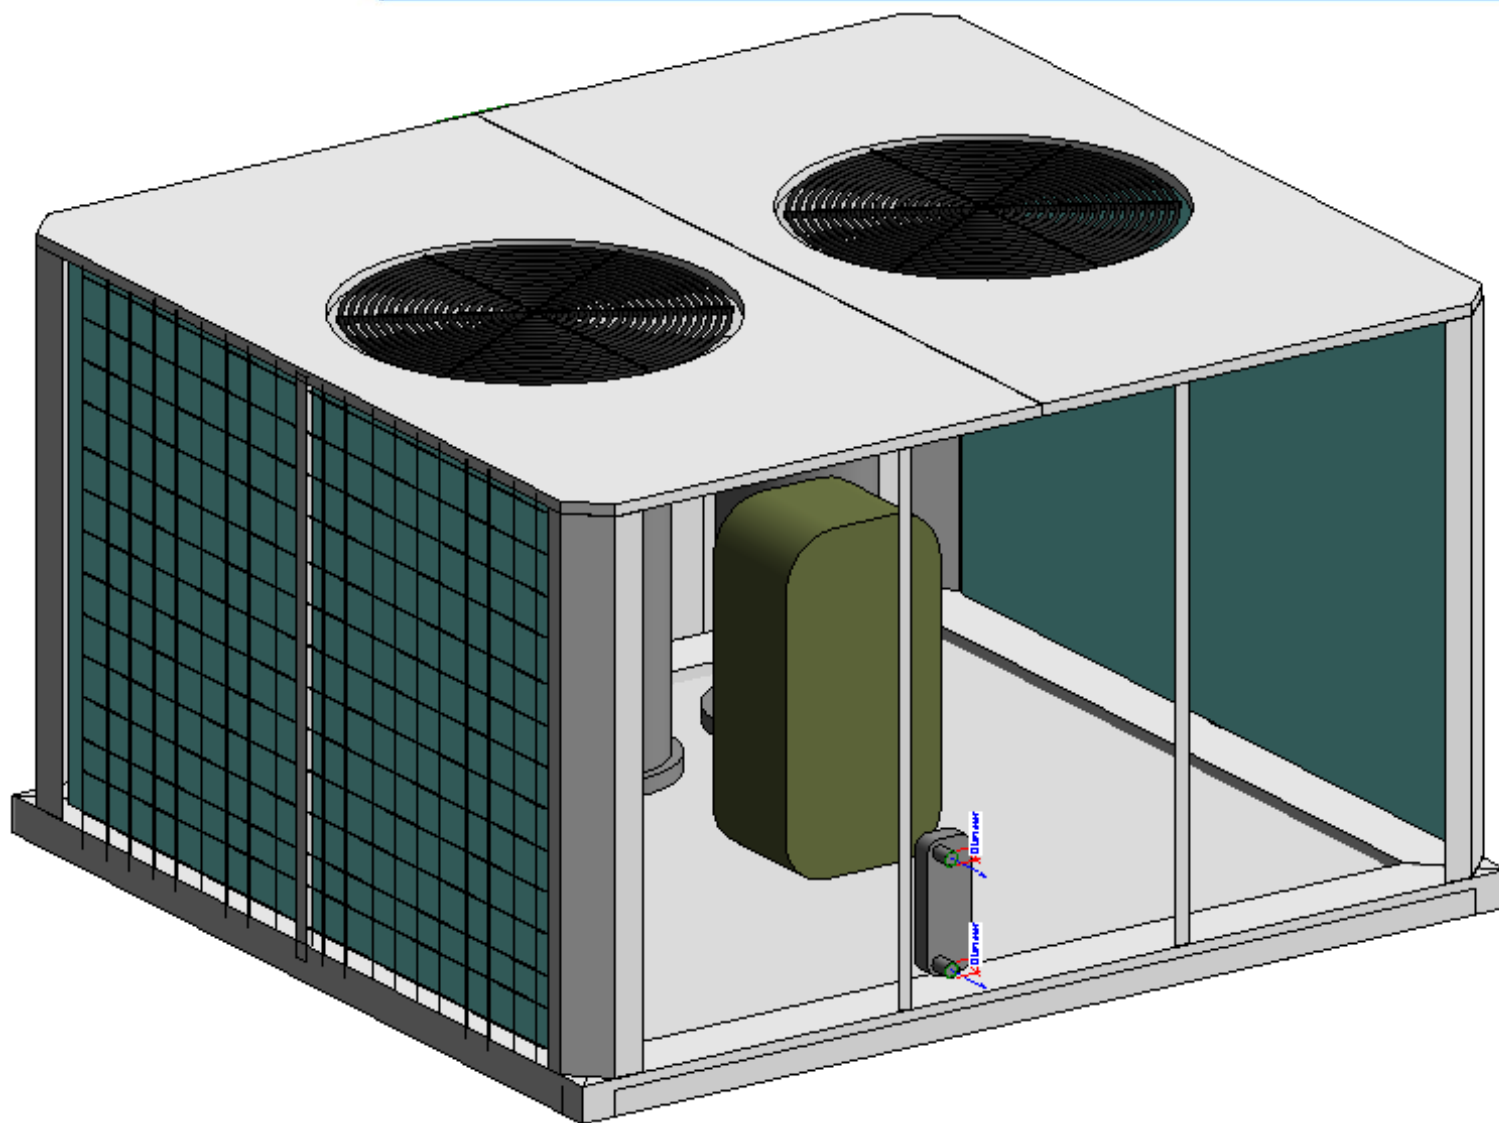

30RQ-090R-TO-120R (Option 264)


Construction	
Opt 12	☐
Opt 264	☒
Opt 266	☐
Opt-49	☐
Service Area	☐
Opt 307	☐
Standard	☒
Opt 23	☐
Opt 293	☐
Opt 116S/116U/116W/116Y	☐
Opt 116R/116T/116V/116X	☐
Service Area with Buffer tank	☐

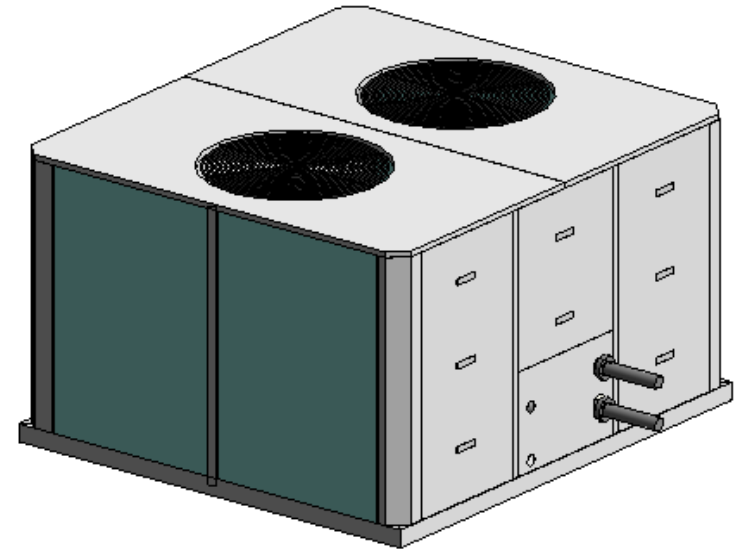

30RQ-090R-TO-120R (Option 266)


Construction

Opt 12	☐
Opt 264	☐
Opt 266	☒
Opt-49	☐
Service Area	☐
Opt 307	☐
Standard	☒
Opt 23	☐
Opt 293	☐
Opt 116S/116U/116W/116Y	☐
Opt 116R/116T/116V/116X	☐
Service Area with Buffer tank	☐

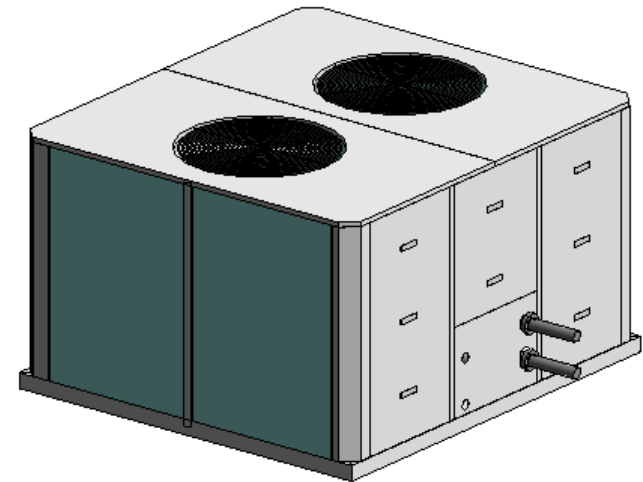

30RQ-090R-TO-120R (Option 12)

Construction	
Opt 12	☒
Opt 264	☐
Opt 266	☐
Opt-49	☐
Service Area	☐
Opt 307	☐
Standard	☒
Opt 23	☐
Opt 293	☐
Opt 116S/116U/116W/116Y	☐
Opt 116R/116T/116V/116X	☐
Service Area with Buffer tank	☐

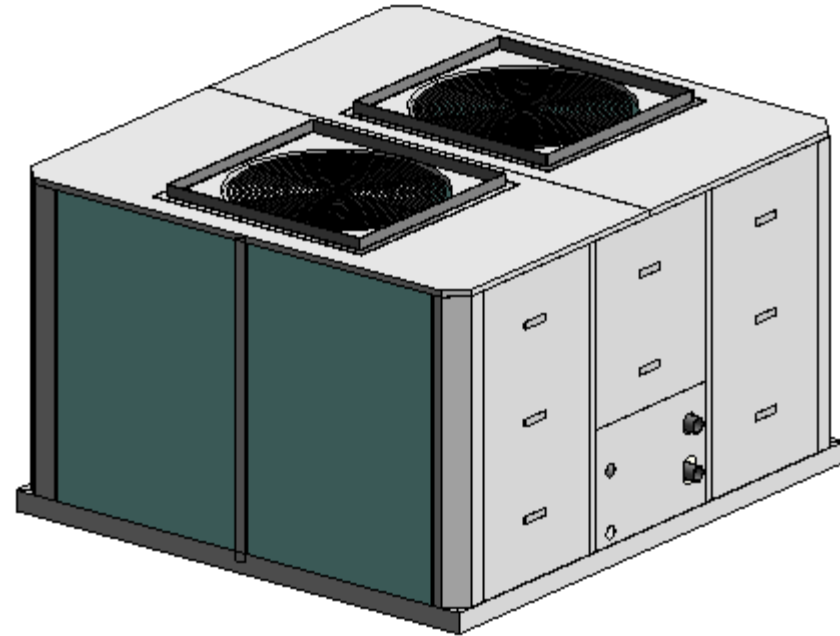

30RQ-090R-TO-120R (Service Area)

Construction	
Opt 12	☐
Opt 264	☐
Opt 266	☐
Opt-49	☐
Service Area	☒
Opt 307	☐
Standard	☒
Opt 23	☐
Opt 293	☐
Opt 116S/116U/116W/116Y	☐
Opt 116R/116T/116V/116X	☐
Service Area with Buffer tank	☐

Construction	
Opt 12	☐
Opt 264	☐
Opt 266	☐
Opt-49	☐
Service Area	☐
Opt 307	☒
Standard	☐
Opt 23	☐
Opt 293	☐
Opt 116S/116U/116W/116Y	☐
Opt 116R/116T/116V/116X	☐
Service Area with Buffer tank	☒

